# VILLAGE OF ASHVILLE WEST STATION STREET CDGB PROJECT HARRISON TOWNSHIP, PICKAWAY COUNTY, OHIO MARCH, 2019

**⊕**BM#1

	LEG	EEND	
	LINE	TYPES	
EXISTING FENCE		xx	xx
EXISTING GAS		GG	G
EXISTING RIGHT-OF-WAY			R/W
EXISTING SANITARY SEWER		SA	SA
EXISTING SANITARY SEWER, FORCE MAIN		FM	FM
EXISTING WATER		w	W
EXISTING STORM SEWER		ST	ST
EXISTING UNDERGROUND TELEPHONE		UGT	UGT
EXISTING UNDERGROUND ELECTRIC		UGE-	UGE
EXISTING OVERHEAD ELECTRIC WIRE POWER POLE W/GUY WIRE & LIGHT POLE		ОНЕ	—ОНЕ— ф
	SYM	BOLS	
EXISTING CATCH BASIN		EXISTING UTILITY POLE	P
EXISTING CURB INLET		EXISTING GAS VALVE	GV⊗
EXISTING SANITARY MANHOLE	0	EXISTING WATER VALVE	WV⊗
EXISTING FIRE HYDRANT	V	EXISTING STORM MANHOLE	0
EXISTING IRON PIN	0	EXISTING GAS METER	GM
EXISTING SIGN	_0_	PROPOSED CATCH BASIN	
EXISTING TREE W/SIZE	( <u>*</u> ")	PROPOSED MANHOLE	•
EXISTING SHRUB		PROPOSED FIRE HYDRANT	4
EXISTING SHRUB ROW	m	ABBREVIAT	ONS
EXISTING LIGHT POLE	ø	EXISTING TOP OF CASTING	
EXISTING POWER POLE	P	ELEVATION	ELE
EXISTING POWER POLE W/LIGHT	P	RIGHT-OF-WAY	R/W

ITEM#	QUANT.	UNIT	DESCRIPTION
202	24	SY	PAVEMENT REMOVED & DISPOSED OF
202	5	EA	CATCH BASIN SEDIMENT FILTER
202	15	SY	WALK REMOVED
207	140	LF	PERIMETER FILTER FABRIC FENCE
252	132	LF	FULL DEPTH PAVEMENT SAWING (ODOT)
253	8	CY	FULL DEPTH PAVEMENT REPAIR (12" DEPTH)
254	860	SY	PAVEMENT PLANING
407	218	GAL	TACK COAT (APPLIED @ 0.25 GAL/SY)
413	132	LF	CRACK SEALING, HOT APPLIED
448	37	CY	1.5" ASPHALT CONCRETE, SURFACE TYPE 1
604	2	EA	MANHOLE ADJUSTED TO GRADE
608	794	SF	CONCRETE WALK, 4"
608	6	EA	CURB RAMPS
608	6	EA	DETECTABLE WARNING, AS PER SUPPLEMENTAL SPEC 15
614	LUMP	LS	MAINTAINING TRAFFIC
624	LUMP	LS	MOBILIZATION
644	12	LF	STOP LINE
644	46	LF	CROSSWALK LINE

THESE QUANTITIES ARE APPROXIMATE ONLY AND ARE NOT TO BE USED FOR PREPARATION OF COST ESTIMATES, BIDS, OR ANY OTHER ESTIMATING PURPOSE WITHOUT VERIFICATION BY THE USER. ANY DISCREPANCIES IN THE QUANTITIES SHALL BE BROUGHT IMMEDIATELY TO THE ATTENTION OF THE ENGINEER FOR EVALUATION.

48/48½ STATION ST. ST. ST.	TON STATION ST.
W. STATION	ST.
ST. STATION ST. STATION ST. ST.	Z33 LONG ST. ST. LUMINIUM ST. SOME ST.
	BM#2
	DEX MAP ALE: 1" = 50'

# SHEET INDEX

IIILE SHEET	
GENERAL NOTES	3
ROADWAY AND SIDEWALK PLAN	
DETAILS	
EROSION CONTROL PLAN	7

UTILITY STATEMENT:
NO UNDERGROUND UTILITY SURVEY WAS PERFORMED BY THE SURVEYOR. THE VERTICAL COMPONENT OF BURIED UTILITIES WAS NOT SURVEYED. LACKING EXCAVATION, THE EXACT LOCATION OF UNDERGROUND FEATURES CANNOT BE ACCURATELY, COMPLETELY, AND RELIABLY DEPICTED. UTILITIES MAY EXIST BENEATH THE GROUND THAT ARE NOT SHOWN HEREON. THE UTILITIES SHOWN ARE BASED ON SURFACE OBSERVATIONS OF MARKINGS BY THE OHIO UTILITIES PROTECTION SERVICE.



CALL TWO WORKING DAYS
BEFORE YOU DIG

800-362-2764 or 8-1-1
www.oups.org

NON-MEMBERS
MUST BE CALLED DIRECTLY

PLAN REVISION SCHEDULE						
CHANGE #	PREPARED BY	DESCRIPTION OF CHANGE	SHEET #	APPROVED BY	DATE	
				1. 1.		

		RUCTION DRAWING	
DRAWING #	DESCRIPTION	DRAWING #	DESCRIPTION
1441	PAVEMENT & UTILITY CUT REPAIR STANDARDS		5-1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1



HORIZONTAL DATUM:
NAD 83: OHIO STATE PLANE - SOUTH ZONE
ACCORDING TO THE OHIO DEPARTMENT OF TRANSPORTATION'S VIRTUAL REFERENCE G

VERTICAL DATUM:
NAVD 88: ACCORDING TO THE OHIO DEPARTMENT OF TRANSPORTATION'S VIRTUAL REFERENCE GPS SYSTEM

BM#1
SOUTHWEST TOP OF CONCRETE SIGN POST BASE, IN PARKING LOT OF ASHVILLE CLEANING CENTER
APPROXIMATE LOCATION: N 626221 E 1841029

ELEVATION = 715.64

BM#2
TOP OF IRON PIN FOUND, WEST SIDE LONG STREET, SOUTH SIDE CONCRETE DRIVE.
APPROXIMATE LOCATION: N 625892, E 1840958

ELEVATION = 711.57

# **APPROVALS**

THE VILLAGE OF ASHVILLE'S SIGNATURES ON THIS PLAN SIGNIFIES ONLY CONCURRENCE WITH THE GENERAL PURPOSE AND LOCATION OF THE PROPOSED IMPROVEMENTS WITH RESPECT TO IMPROVEMENTS WITHIN THE RIGHT-OF-WAY, STORM WATER MANAGEMENT, EROSION AND SEDIMENT CONTROL. ALL TECHNICAL DETAILS REMAIN THE RESPONSIBILITY OF THE PROFESSIONAL ENGINEER WHO PREPARED AND CERTIFIED THESE PLANS.

MAYOR, VILLAGE OF ASHVILLE

The state of the

# PROFESSIONAL ENGINEER

THIS IS TO CERTIFY THAT GOOD ENGINEERING PRACTICES HAVE BEEN UTILIZED IN THE DESIGN OF THIS PROJECT AND THAT ALL OF THE MINIMUM STANDARDS OF THE VILLAGE OF ASHVILLE HAVE BEEN MET, INCLUDING THOSE STANDARDS GREATER THAN MINIMUM WHERE, IN MY OPINION, THEY ARE NEEDED TO PROTECT THE SAFETY OF THE PUBLIC. ANY VARIANCES TO THE ABOVE STANDARDS ARE CONSISTENT WITH SOUND ENGINEERING PRACTICE AND ARE NOT DETRIMENTAL TO THE PUBLIC SAFETY AND CONVENIENCE.

Christopher Michael Tebbe E-68106

PROFESSIONAL ENGINEER

Christopher Michael Tebbe E-68106

PROFESSIONAL ENGINEER

STREET SUPERINTENDENT, VILLAGE OF ASHVILLE

for 2019

5792 Gaelic Court Dublin, Ohio 43016

ST STATION STREET CDGB PROJI WEST STATION STREET

REVISIONS

JOB NO. 1009
DRAWN BY MJM
DESIGN BY MJM
CHECKED BY CMT

SHEET

1

- 1

## GENERAL PLAN NOTES (09-16-16)

GEN 1 THE VILLAGE OF ASHVILLE REQUIREMENTS, TOGETHER WITH THE LATEST EDITION OF THE STATE OF OHIO DEPARTMENT OF TRANSPORTATION AND THE CITY OF COLUMBUS CONSTRUCTION AND MATERIAL SPECIFICATION, SHALL GOVERN ALL CONSTRUCTION ITEMS, MATERIAL, WORKSMANSHIP, ECT THAT ARE A PART OF THIS PLAN, INFORCE ON THE DATE OF CONTRACT, UNLESS OTHERWISE NOTED. EXCEPT AS SUCH SPECIFICATIONS ARE MODIFIED BY THE FOLLOWING GENERAL NOTES AND/OR SPECIFICATIONS OR BYT THE CONSTRUCTION DETAILS SET FORTH HEREIN. THE CONTRACTOR SHALL ALSO CONFORM TO REQUIREMENTS OF THE VILLAGE OF ASHVILLE GENERAL PROVISIONS AND THE STANDARD CITY OF COLUMBUS DETAIL CONSTRUCTION DRAWINGS. IF THERE ARE ANY DISCREPANCIES, THE VILLAGE OF ASHVILLE REQUIREMENTS SHALL GOVERN.

GEN 2 ANY MODIFICATION TO THE SPECIFICATIONS OR CHANGES TO WORK AS SHOWN ON THESE DRAWINGS MUST HAVE PRIOR WRITTEN APPROVAL BY THE VILLAGE ENGINEER.

GEN 3 THE CONTRACTOR OR SUBCONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR COMPLYING WITH ALL FEDERAL, STATE, AND LOCAL SAFETY REQUIREMENTS, TOGETHER WITH EXERCISING PRECAUTIONS AT ALL TIMES FOR PROTECTION OF PERSONS (INCLUDING EMPLOYEES) AND PROPERTY. IT IS ALSO THE SOLE RESPONSIBILITY OF THE CONTRACTOR OR SUBCONTRACTOR TO INITIATE, MAINTAIN, AND SUPERVISE ALL SAFETY REQUIREMENTS, PRECAUTIONS, AND PROGRAMS IN CONNECTION WITH THE WORK. THE CONTRACTOR OR SUBCONTRACTOR SHALL ALSO ABIDE BY ALL ORDINANCES OF THE VILLAGE OF ASHVILLE,

GEN 4 PRIOR TO BIDDING THE CONTRACTOR SHALL, BY PERSONAL EXAMINATION, SATISFY THEMSELVES AS TO THE LOCATION OF THE PROPOSED WORK AND TO ACQUAINT THEMSELVES THOROUGHLY WITH THE EXISTING CONDITIONS AND THE DIFFICULTIES THAT ARE LIKELY TO BE ENCOUNTERED IN THE PERFORMANCE OF THE PROPOSED WORK. THIS IS ESPECIALLY TRUE WITH REGARD TO ANY REMOVAL ITEMS.

GEN 5 ALL WORK SHALL BE COMPLETELY ACCEPTABLE TO THE VILLAGE OF ASHVILLE OFFICIALS. NO WORK SHALL BE COMMENCED UNTIL ARRANGEMENTS HAVE BEEN MADE WITH THE VILLAGE OF ASHVILLE ENGINEER FOR INSPECTION. NECESSARY LINE AND GRADE STAKING WILL BE PROVIDED BY THE DEVELOPER. CUT SHEETS SHALL BE SUBMITTED AND APPROVED BY THE VILLAGE PRIOR TO THE BEGINNING OF CONSTRUCTION.

GEN 6 PRIOR TO BEGINNING CONSTRUCTION, THE CONTRACTOR SHALL MAKE ALL ARRANGEMENTS NECESSARY TO COORDINATE AND PROVIDE FULL-TIME INSPECTION SERVICE BY THE VILLAGE FOR THE PROPOSED WORK. COST OF INSPECTION SHALL BE PAID FOR BY THE DEVELOPER.

GEN 7 THE CONTRACTOR SHALL PROVIDE WRITTEN NOTIFICATION TO THE VILLAGE OF ASHVILLE ENGINEERING DEPARTMENT AT LEAST SEVEN (7) DAYS PRIOR TO ANY CONSTRUCTION.

GEN 8 THE CONTRACTOR OR DEVELOPER SHALL SECURE AND PAY FOR ALL NECESSARY PERMITS AND GOVERNMENT FEES, LICENSES, AND INSPECTIONS FOR THE PROPER EXECUTION AND COMPLETION OF THE IMPROVEMENTS SHOWN ON THE PLANS PRIOR TO CONSTRUCTION. ALL PERTINENT STANDARD CONSTRUCTION DRAWINGS ARE AVAILABLE UPON REQUEST OF THE OFFICE OF THE VILLAGE ENGINEER.

GEN 9 THE CONTRACTOR SHALL NOTIFY ALL OF THE AFFECTED PROPERTY OWNERS AT LEAST TWO (2) WEEKS PRIOR TO THE SCHEDULED COMMENCEMENT OF WORK ON THE JOB SITE. THIS LETTER SHALL STATE THE DATE CONSTRUCTION IS TO BEGIN AND THAT RESIDENT SHOULD REMOVE ANY ITEMS, EXAMPLE: SHRUBS, SPOT LIGHTS, FENCES, STONES OR BRICKS, ETC., WHICH MAY FALL WITHIN THE WORK LIMITS. THE LETTER SHOULD ALSO CONTAIN THE NAME AND A TWENTY-FOUR (24) HOUR PHONE NUMBER OF A CONTACT, FROM THE CONTRACTOR'S FIRM, WHO COULD BE CONTACTED IN CASE OF EMERGENCY. THIS LETTER, FOR CONVENIENCE PURPOSES, SHALL CONTAIN A PHONE NUMBER FOR ALL LOCAL LAW ENFORCEMENT AGENCIES AND FIRE SAFETY FORCES.

GEN 10 EXISTING UTILITIES SHOWN ARE FROM BEST AVAILABLE RECORDS AND FIELD INVESTIGATION, AND ARE NOT NECESSARILY COMPLETE OR EXACT. THE CONTRACTOR IS RESPONSIBLE FOR THE INVESTIGATION, LOCATION, SUPPORT, PROTECTION AND RESTORATION OF ALL EXISTING UTILITIES AND APPURTENANCES WHETHER SHOWN ON THESE PLANS OR NOT. THE CONTRACTOR SHALL EXPOSE ALL UTILITIES OR STRUCTURES PRIOR TO CONSTRUCTION TO VERIFY THE VERTICAL AND HORIZONTAL EFFECT OF THE PROPOSED CONSTRUCTION, AND SHALL MAKE ADJUSTMENTS IN ELEVATIONS AS DIRECTED BY THE VILLAGE ENGINEER TO PROVIDE SUFFICIENT CLEARANCE BETWEEN THE PROPOSED AND EXISTING UTILITIES. THE CONTRACTOR SHALL CONTACT THE OHIO UTILITIES PROTECTION SERVICE (OUPS) AT 1-800-362-2764 THREE (3) WORKING DAYS PRIOR TO WORK IN THE VICINITY OF THEIR UNDERGROUND LINES AND ACCORDING TO 153.64, OHIO REVISED CODE (ORC) SHALL NOTIFY ALL UTILITY COMPANIES AT LEAST FORTY-EIGHT (48) HOURS PRIOR TO WORK IN THE VICINITY OF THEIR UNDERGROUND LINES.

GEN 11 THE FOLLOWING UTILITIES AND OWNERS ARE LOCATED WITHIN THE WORK LIMITS OF THIS PROJECT AND DO SUBSCRIBE TO A REGISTERED UNDERGROUND UTILITY SERVICES:

500 LANCASTER PIKE
CIRCLEVILLE, OH 43113
(740) 474-5033

COLUMBIA GAS

TRANSMISSION

(614) 653-4422

1440 MCNAUGHTON ROAD

COLUMBUS, OH 43232

VERIZON

AMERICAN ELECTRIC POWER 1320 SUGAR GROVE ROAD LANCASTER, OHIO 43130 (740) 689-4700

TIME WARNER **COMMUNICATIONS** 1315 GRANVILLE PIKE LANCASTER, OHIO 43130

(740) 635-9685

**SOUTH CENTRAL POWER COMPANY** 140 WEST WHEELING STREET LANCASTER, OHIO 43130 2780 COONPATH ROAD, NE (740) 687-6696 LANCASTER, OHIO 43130

COLUMBIA GAS OF OHIO 843 PLATT AVENUE CHILLICOTHE, OHIO 45601 (614) 772-9224

> \* VILLAGE OF ASHVILLE SERVICE DEPARTMENT **160 CHERRY STREET** ASHVILLE, OHIO 43103 (740) 983-4053

WATERLINE SANITARY SEWER & STORM SEWER ONLY 200 EAST STATION STREET ASHVILLE, OHIO 43103 (740) 983-6367

# \* THE VILLAGE OF ASHVILLE DOES NOT SUBSCRIBE OR IS A MEMBER OF OUPS

GEN 12 THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIES ON AS BEING EXACT OR COMPLETE. THE VILLAGE OF ASHVILLE AND/OR ENGINEER ASSUMES NO RESPONSIBILITY AS TO THE ACCURACY OR DEPTHS OF THE UNDERGROUND FACILITIES AS SHOWN ON THE PLANS. THE CONTRACTOR MUST CALL APPROPRIATE UTILITY COMPANY AT LEAST SEVEN (7) DAYS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY FOR THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.

GEN 13 THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING THE RELOCATION OF ANY UTILITIES AS REQUIRED BY THE PLAN WITH THE OWNER OF THE AFFECTED UTILITY.

GEN 14 WHERE POTENTIAL GRADE CONFLICTS MIGHT OCCUR WITH EXISTING UTILITIES, THE CONTRACTOR WILL BE REQUIRED TO UNCOVER SUCH UTILITIES SUFFICIENTLY IN ADVANCE OF LAYING PIPE OR DUCT IN ORDER THAT THE ENGINEER MAY DETERMINE THE EXACT ELEVATION AND MAKE ANY NECESSARY ADJUSTMENTS. COST OF THE ABOVE SHALL BE INCLUDED IN THE PRICE BID FOR THE VARIOUS ITEMS IN THE CONTRACT.

GEN 15 ALL MATERIALS INCLUDING PIPING, APPURTENANCES, MANHOLES, GRAVEL, ETC. TO BE UTILIZED FOR DEDICATED PUBLIC UTILITIES OR ROADWAYS MUST BE APPROVED BY THE VILLAGE OF ASHVILLE

GEN 16 ALL FIELD TILES BROKEN DURING EXCAVATION SHALL BE REPLACED BY THE CONTRACTOR TO ORIGINAL CONDITION OR CONNECTED TO THE CURB SUB DRAIN OR TO THE STORM SEWER SYSTEMS AS DIRECTED BY THE ENGINEER.

# GENERAL PLAN NOTES (CONTINUED)

GEN 17 TWENTY-FOUR (24) HOUR ADVANCE NOTIFICATION IS REQUIRED FOR ALL WORK REQUIRING INSPECTION, TESTING, OR APPROVAL BY THE VILLAGE ENGINEER OR BUILDING DEPARTMENTS.

GEN 18 THE CONTRACTOR SHALL REPAIR OR REPLACE ANY AND ALL EXISTING WORK DAMAGED DURING OR DUE TO THE EXECUTION OF THIS CONTRACT TO EQUAL OR BETTER CONDITION PRIOR TO THE DAMAGE, AT THEIR OWN EXPENSE. ALL SAID WORK TO BE REPAIRED OR REPLACED TO THE SATISFACTION OF THE DEVELOPER'S ENGINEER AND VILLAGE OF ASHVILLE ENGINEER. ANY DAMAGE TO OTHER UTILITIES CAUSED BY THE CONTRACTOR SHALL BE REPAIRED BY THE APPROPRIATE UTILITY COMPANY AT THE CONTRACTOR'S EXPENSE.

GEN 19 CARE SHALL BE EXERCISED WHEN WORKING THE AREA AROUND EXISTING TREES AND SHRUBS. ANY TREES OR SHRUBS NOT MARKED FOR REMOVAL THAT ARE DAMAGED BY THE CONTRACTOR WILL HAVE TO BE REPLACED BY THE CONTRACTOR TO THE SATISFACTION OF THE OWNER.

GEN 20 ANY PROPERTY CORNER PINS OR PERMANENT SURVEY MARKERS DISTURBED DURING CONSTRUCTION SHALL BE RESET BY A REGISTERED SURVEYOR AT THE CONTRACTOR'S EXPENSE.

GEN 21 EXISTING STRUCTURES TO BE REMOVED OR DEMOLISHED REQUIRE A "DEMOLITION PERMIT" ISSUED BY THE VILLAGE OF ASHVILLE ENGINEER.

GEN 22 THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING MAIL SERVICE IN THE CONSTRUCTION AREA.

GEN 23 THE CONTRACTOR SHALL NOT ORDER MATERIAL OR PERFORM WORK FOR ITEMS DESIGNATED BY PLAN NOTE TO BE USED "AS DIRECTED BY THE ENGINEER" UNLESS AUTHORIZED BY THE ENGINEER. THE ACTUAL WORK LOCATIONS AND QUANTITIES USED FOR SUCH ITEMS SHALL BE INCORPORATED INTO THE FINAL CHANGE ORDER GOVERNING COMPLETION OF THIS PROJECT.

GEN 24 ALL ITEMS OF WORK CALLED FOR ON THE PLANS FOR WHICH NO SPECIFIC METHOD OF PAYMENT IS PROVIDED SHALL BE PERFORMED BY THE CONTRACTOR AND THE COST OF IT SHALL BE INCLUDED IN THE PRICE BID FOR THE VARIOUS RELATED ITEMS.

GEN 25 ALL EXCAVATION ON THIS PROJECT IS UNCLASSIFIED. THE CONTRACTOR SHALL MAKE ALL EXCAVATION OF WHATEVER NATURE NECESSARY FOR CONSTRUCTION OF WATER LINES AND SEWERS AND THEIR APPURTENANT STRUCTURES INCLUDED IN THIS PROJECT.

GEN 26 APPROVALS OF CONSTRUCTION PLANS IS CONTINGENT ON ALL EASEMENTS REQUIRED FOR THE CONSTRUCTION OF THE WORK BEING SECURED AND SHOWN ON THE FINAL PLAT FOR RECORDING. NO WORK THAT REQUIRES AN EASEMENT WILL BE ALLOWED TO PROCEED UNTIL THIS HAS BEEN DONE.

GEN 27 TWENTY-FOUR (24) HOUR ADVANCE NOTIFICATION IS REQUIRED FOR ALL WORK REQUIRING INSPECTION, TESTING, OR APPROVAL BY THE VILLAGE ENGINEER OR BUILDING DEPARTMENTS.

GEN 28 THE CONTRACTOR IS RESPONSIBLE TO NOTIFY THE VILLAGE ENGINEER AND REQUEST A FINAL PUNCH-OUT INSPECTION OF THE SITE ONCE ALL OF THE ITEMS ON THE APPROVED DEVELOPMENT PLANS HAS BEEN COMPLETED.

GEN 29 THE CONTRACTOR SHALL SUFFICIENTLY EXPOSE EACH UTILITY OR STRUCTURE INDICATED ON THE PLANS IN ADVANCE OF EXCAVATING TO DETERMINE IF A GRADE CONFLICT OCCURS. LOCATIONS SHOWN ARE APPROXIMATE ONLY. OTHER UTILITIES NOT MARKED MAY ALSO REQUIRE EXPOSING.

GEN 30 THE DEVELOPER IS RESPONSIBLE FOR HAVING "AS-BUILT" CONSTRUCTION DRAWINGS SENT TO THE VILLAGE ENGINEER AFTER THE PROJECT HAS BEEN COMPLETED. THE PLANS MUST INCLUDE TOP-OF-CASTING AND FLOW-LINE ELEVATIONS FOR ALL SANITARY AND STORM STRUCTURES AND IDENTIFY ALL FIELD MODIFICATIONS TO THE APPROVED PLAN SET. THE "AS BUILT" DRAWINGS MUST ALSO INCLUDE STATE PLANE COORDINATES FOR ALL NEWLY CONSTRUCTED PUBLIC UTILITY STRUCTURES.

GEN 31 ACCESS TO ALL ADJOINING PROPERTIES SHALL BE MAINTAINED AT ALL TIMES, UNLESS OTHERWISE SHOWN ON THE DRAWINGS.

GEN 32 ALL SITE CLEARING SHALL BE PERFORMED BY THE OWNER AT HIS EXPENSE PRIOR TO CONSTRUCTION OF THIS PROJECT SUBJECT TO COMPLIANCE WITH THE VILLAGE OF ASHVILLE ZONING CODE.

GEN 33 ALL TREES, EITHER STANDING OR FALLEN, AND STUMPS WITHIN THE CONSTRUCTION LIMITS SHALL BE REMOVED UNDER THE LUMP SUM BID FOR ITEM 201, CLEARING AND GRUBBING UNLESS DIRECTED

GEN 34 AT ALL UTILITY CROSSINGS, THE BACKFILL SHALL CONSIST OF COMPACTED GRANULAR MATERIAL IN ACCORDANCE WITH C.M.S.C. ITEM 912 BETWEEN THE DEEPER AND SHALLOWER PIPE. WHERE PROPOSED UTILITIES OR SERVICES CROSS PROPOSED OR EXISTING PAVEMENT AREAS, BACKFILL SHALL BE COMPACTED GRANULAR MATERIAL IN ACCORDANCE WITH C.M.S.C. ITEM 912 EXTENDING AT LEAST THREE (3) FEET BEYOND THE BACK OF CURB OR EDGE OF PAVEMENT. THE COST IS TO BE INCLUDED IN THE PRICE BID FOR RELATED PIPE, C.M.S.C. ITEM 912 MAY BE SUBSTITUTED.

GEN 35 IN THE EVENT THAT IT BECOMES NECESSARY, THE VILLAGE OF ASHVILLE SHALL PERFORM WORK OF AN IMMEDIATE NATURE REQUIRED OF THE CONTRACTOR BY THIS CONTRACT BECAUSE OF THE FAILURE OR REFUSAL OF THE CONTRACTOR TO PERFORM-SUCH WORK, THE CONTRACTOR SHALL REIMBURSE THE VILLAGE OF ASHVILLE AT THE RATE OF 2.5 TIMES THE ACTUAL COST OF LABOR, MATERIALS AND EQUIPMENT NECESSARY TO PERFORM SUCH WORK. THE VILLAGE OF ASHVILLE SHALL BE REQUIRED TO NOTIFY OR ATTEMPT TO NOTIFY THE DESIGNATED REPRESENTATIVE OF THE CONTRACTOR OF THE NECESSITY TO PERFORM SUCH WORK. IN THE EVENT OF AN EMERGENCY, NO NOTIFICATION IS REQUIRED. IF THE CONTRACTOR REFUSES OR FAILS WITHIN A REASONABLE TIME TO PERFORM OR CAUSE THE PERFORMANCE OF SUCH WORK, THE VILLAGE OF ASHVILLE SHALL BE REIMBURSED BY THE CONTRACTOR IN THE AMOUNT PROVIDED HEREIN. REASONABLE TIME FOR ALL STREETS INVOLVED ON THIS CONTRACT IS ONE (1) HOUR FROM THE TIME OF NOTIFICATION BY THE VILLAGE OF ASHVILLE.

GEN 36 PRIOR TO THE CONSTRUCTION OF THE STREETS, SOIL TESTS SHALL BE MADE ON ALL SANITARY SEWER AND DESIGNATED STORM SEWER TRENCHES WHICH CROSS THE PROPOSED PAVEMENTS OR WHICH LIE SUCH .THAT THE PROPOSED PAVEMENTS ARE LOCATED WITHIN ANY PART OF THE INFLUENCE LINE OF SAID TRENCH. WHERE SAID RESULTS INDICATED THAT THE TRENCH BACKFILL DOES NOT MEET THE COMPACTION REQUIREMENTS OF 912.03 OF THE CONSTRUCTION AND MATERIAL SPECIFICATIONS, ALL BACKFILL MATERIAL SHALL BE REMOVED, REPLACED AND RE-TESTED UNTIL COMPACTION MEETS REQUIREMENTS OF 912.03.

GEN 37 ALL SIDEWALKS, CURB ROMPS, AND CURBS AND GUTTERS SHALL MEET FEDERAL A.D.A. (AMERICANS WITH DISABILITIES ACT) REQUIREMENTS, LATEST EDITION.

GEN 38 ANY EXISTING PAVEMENT REMOVED FOR SANITARY SEWER, STORM SEWER OR WATERLINE PLACEMENT SHALL BE BACKFILLED AND COMPACTED TO A MAXIMUM DENSITY OF 100X OR WITH. CONTROLLED DENSITY FILL (CDF), REFERENCE CITY OF COLUMBUS ITEM 912 OR 636. IF CDF IS USED ALL DUCTILE OR COST IRON PIPE IN CONTACT WITH CDF SHALL BE POLY-WRAPPED IN ACCORDANCE WITH C-7484 OR AWWA C-105.

GEN 39 ANY TUNNELING OR BORING OF ANY PIPELINES SHALL BE IN ACCORDANCE WITH PLANS APPROVED BY THE VILLAGE ENGINEER.

# GENERAL PLAN NOTES (CONTINUED)

GEN 40 DURING THE CONSTRUCTION OF THE IMPROVEMENTS SHOWN ON THESE PLANS, SEDIMENTATION AND EROSION CONTROL SHALL BE CONTROLLED IN ACCORDANCE WITH APPLICABLE STATE AND FEDERAL REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION AND SEDIMENT CONTROL IN ACCORDANCE WITH EPA STANDARDS WHERE NEEDED FOR THE DURATION OF THE PROJECT. ALL COSTS ASSOCIATED WITH SEDIMENTATION AND EROSION CONTROL SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE PIPE.

GEN 41 THE CONTRACTOR SHALL, PRIOR TO BIDDING, CAREFULLY STUDY THE GEOTECHNICAL REPORT, AS PROVIDED AS A PART OF THE BID DOCUMENTS, AND MAKE SITE VISITS TO SATISFY HIMSELF OF THE SITE CONDITIONS. THE CONTRACTOR SHALL, AS A PART OF HIS BID, SUBMIT A DETAILED DEWATERING PLAN THAT SHALL INCLUDE THE NUMBER AND SPACING OF WELL POINTS, THE SIZE OF PUMPS TO BE USED, THE POINTS OF DISCHARGE OF SAID DEWATERING OPERATIONS, AND ANY OTHER INFORMATION PERTINENT TO THE DEWATERING OF THE PROJECT. NO EXTRA PAYMENT SHALL BE MADE FOR DEWATERING. ALL COSTS FOR DEWATERING SHALL BE INCLUDED IN THE UNIT PRICE BID FOR ASSOCIATED ITEMS. BY SUBMITTING A BID THE CONTRACTOR IS STATING THAT HE CLEARLY UNDERSTANDS THE SCOPE OF THE DEWATERING FOR THE PROJECT AND HAS INCLUDED THIS WORK IN HIS UNIT PRICE BID FOR ASSOCIATED ITEMS.

GEN 42 THE CITY OF COLUMBUS STANDARD DRAWINGS SHALL GOVERN ALL PROJECTS UNLESS OTHERWISE NOTED.

GEN 43 THE CONTRACTOR SHALL CLEAN UP- ALL DEBRIS AND MATERIALS RESULTING FROM HIS OPERATIONS AND RESTORE ALL SURFACES, STRUCTURES, DITCHES, AND PROPERTY TO ITS ORIGINAL CONDITION TO THE SATISFACTION OF THE ENGINEER.

GEN 44 THE CONTRACTOR SHALL CONFINE HIS ACTIVITIES TO THE PROJECT SITE UNDER DEVELOPMENT OR THE EXISTING RIGHT-OF-WAYS, CONSTRUCTION, AND PERMANENT EASEMENTS AND SHALL NOT TRESPASS UPON OTHER PRIVATE PROPERTY WITHOUT THE WRITTEN CONSENT OF THE OWNER.

GEN 45 THE CONTRACTOR SHALL DISPOSE OF ALL SURPLUS EXCAVATION OFF-SITE OR MOUND FOR FUTURE SECTIONS MOUNDED MATERIAL SHALL BE DRESSED-UP, STABILIZED AND SEEDED ACCORDING TO SPECIFICATIONS. MOUNDS SHALL NOT EXCEED TO THE HEIGHT AND SHALL NOT INTERFERE WITH SITE DRAINAGE.

GEN 46 THE INFORMATION SHOWN CONCERNING EXISTING UTILITIES IS NOT REPRESENTED, WARRATED, OR GUARANTEED TO BE COMPLETE OR ACCURATE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PHYSICALLY LOCATE AND VERIFY, IN THE FIELD, ALL UTILITY LOCATIONS AND ELEVATIONS, WHETHER SHOWN ON THE PLAN OR NOT, PRIOR TO THE BEGINNING OF CONSTRUCTION OPERATIONS. THE CONTRACTOR SHALL SUPPORT, PROTECT, AND RESTORE ALL EXISTING UTILITIES AND THEIR ASSOCIATED ITEMS.

GEN 47 COMPLIANCE WITH THE OCCUPATIONAL SAFETY AND HEALTH ACT OF 1970 IS REQUIRED OF ALL CONTRACTORS ON THIS PROJECT.

GEN 48 WHERE MANHOLES ARE LOCATED WITHIN STREET GRADING LIMITS, THE TOPS SHALL BE BUILT TO ELEVATIONS SHOWN OR ORDERED. ELSEWHERE MANHOLES SHALL BE BUILT OR SUBSEQUENT ADJUSTED TO MEET SURFACE GRADES ESTABLISHED FOR THE DEVELOPMENT. THE COST OF THE ADJUSTMENT IS TO BE INCLUDED IN THE PRICE BID FOR THE MANHOLE.

GEN 49 THE CONTRACTOR SHALL CLEAN UP ALL DEBRIS AND MATERIAL RESULTING FROM HIS OPERATION AND RESTORE ALL OTHER SURFACES, STRUCTURES, DITCHES, ON PUBLIC AND ADJACENT PROPERTY TO THERE ORIGINAL CONDITIONS TO THE SATISFACTION OF THE ENGINEER AND THE DEVELOPER'S PROPERTY TO THEIR SATISFACTION. ALL COSTS FOR THIS WORK SHALL BE INCLUDED WITH THE PRICE BID FOR THE VARIOUS ITEMS.

RDW 1 ALL PAVEMENT SUB-GRADE SHALL BE CONSTRUCTED IN ACCORDANCE WITH ITEM 203 OF THE CITY OF COLUMBUS CONSTRUCTION AND MATERIAL SPECIFICATIONS, THE SOILS REPORT AND AS DIRECTED BY THE REGISTERED SOILS ENGINEER PRESENT ON THE SITE. SECTION 203.12 SHALL BE MODIFIED SUCH THAT ALL COMPACTION SHALL BE TO ONE HUNDRED (100) PERCENT OF THE MAXIMUM DRY UNIT WEIGHT OBTAINED IN THE LABORATORY BY THE "STANDARD PROCTOR" COMPACTION TEST (ASTM D698). MOISTURE CONTENT OF THE NEW FILL SHALL BE IN RANGE OF + TWO (2) PERCENT OF THE OPTIMUM MOISTURE CONTENT DETERMINED BY AST D698.

RDW 2 PRIOR TO CONSTRUCTION OF THE STREETS, SOIL TESTS SHALL BE MADE ON ALL SANITARY SEWER AND DESIGNATED STORM SEWER TRENCHES WHICH CROSS PROPOSED PAVEMENTS OR WHICH LIE SUCH THAT THE PROPOSED PAVEMENTS ARE LOCATED WITHIN ANY PART OF THE INFLUENCE LINE OF SAID TRENCH. WHERE SAID RESULTS INDICATE THAT THE TRENCH BACKFILL DOES NOT MEET THE COMPACTION REQUIREMENTS OF 912.03 (MINIMUM OF 100 % OF MAXIMUM LABORATORY DENSITY) OF THE CONSTRUCTION AND MATERIAL SPECIFICATIONS, ALL BACKFILL MATERIAL SHALL BE REMOVED, REPLACED, AND RE-TESTED UNTIL COMPACTION MEETS SAID REQUIREMENTS OF 912.03.

RDW 2 ALL PAVEMENT JOINTS, PARTICULARLY WHERE A PROPOSED PAVEMENT ABUTS AN EXISTING PAVEMENT, AND ALL PAVEMENT JOINTS ABUTTING UTILITY STRUCTURES SUCH AS MANHOLES, CATCH BASINS, VALVE BOXES, ETC. SHALL BE SEALED IN ACCORDANCE WITH ITEM 413 TYPE (1) OF THE CITY OF COLUMBUS CONSTRUCTION AND MATERIAL SPECIFICATIONS.

RDW 3 THE CONTRACTOR SHALL CONTACT THE COLUMBIA GAS OF OHIO, INC. OPERATIONS SUPERVISOR AT 614-818-2109 ONE (1) WEEK PRIOR TO ROADWAY CONSTRUCTION FOR THE DELIVERY OF PVC GAS SLEEVES OR COLUMBUS SOUTHERN POWER COMPANY ENGINEERING LIAISON COORDINATOR AT 614-464-7379 FOR ELECTRIC CONDUIT SLEEVES.

RDW 4 AT THE OPTION OF THE DEVELOPER OR THE VILLAGE, THE PLACEMENT OF THE FINAL WEARING COURSE OF ITEM 404 ASPHALT CONCRETE MAY BE DELAYED UNTIL SUCH TIME THAT THE MAJORITY OF THE RESIDENTIAL HOUSING CONSTRUCTION IN THE AREA IS COMPLETE OR WEATHER PERMITS.

RDW 5 WEARING COURSE OF ASPHALT CONCRETE IS TO MEET CITY OF COLUMBUS CONSTRUCTION AND MATERIAL SPECIFICATION ITEM 404 AND ADDITIONAL MIX DESIGN REQUIREMENTS OF THE VILLAGE OF ASHVILLE.

RDW 6 PAVEMENT CUTS FOR UTILITY LINE INSTALLATIONS ARE SUBJECT TO THE BACKFILL REQUIREMENTS OF ITEM 912 IN LIEU OF COMPACTED GRANULAR MATERIAL, FLOWABLE CONTROLLED DENSITY FILL, ITEM 636 TYPE-11 MAY BE USED. PAVEMENT SHALL BE CONSTRUCTED TO MATCH THE EXISTING SECTION OR NINE INCHES OF ITEM 404 ASPHALT CONCRETE, WHICHEVER IS GREATER. AS AN OPTION, THE CONCRETE BASE EXTENDING ONE (1) FOOT BEYOND EITHER EDGE OF THE EXCAVATION, WITH TWO (2) INCHES OF ITEM 404 ASPHALT WEARING COURSE PLACED ON TOP.

RDW 7 STEEL PLATES SHALL BE POSITIONED AND SECURED IN PLACE WITH STEEL SPIKES AND COLD PATCH ASPHALT MIX OVER ALL TRENCHES THAT ARE LEFT OPEN ON A TEMPORARY BASIS AND SUBJECT TO TRAFFIC.

RDW 8 VILLAGE STREETS ARE TO BE KEPT CLEAN AND FREE FROM MUD, STONE, DIRT, ETC. A TEMPORARY CONSTRUCTION ENTRANCE COMPRISED OF A 20' X 50' MAT OF NUMBER 2 STONE IS TO BE MAINTAINED AT ALL SITE ENTRANCES.

RDW 9 CONCRETE CURBS ARE TO BE BRANDED DURING PLACEMENT UTILIZING THE STANDARD BRAND SET PROVIDED BUY THE VILLAGE OF ASHVILLE ENGINEER. BRAND CURBS ARE AS FOLLOWS:

"S" - ON TOP OF CURB FOR SANITARY LATERAL LOCATIONS

"W" - ON FACE OF CURB FOR WATER SERVICE BOX LOCATIONS. "WV" - ON FACE OF CURB FOR HYDRANT WATCH VALVE LOCATIONS.

"WM" - ON FACE OF CURB FOR WATER MAIN VALVE LOCATIONS.

BRANDS THAT ARE MISSED MUST BE MECHANICALLY GROUNDED INTO CURB AFTER THE CONCRETE IS SET.

# ROADWAY NOTES (CONTINUED)

RDW 10 THE COMBINATION CURB AND GUTTER SHALL BE PLACED CONTINUOUSLY. DRIVEWAY KNOCK DOWNS SHALL BE SAW-CUT AT THE TIME EACH INDIVIDUAL RESIDENT IS CONSTRUCTED.

RDW 11 MONUMENT BOXES SHALL BE INSTALLED AT INTERSECTIONS DESIGNATED ON THE PLAN. BOXES SHALL BE NEENAH R-1968, TYPE 36-8 OR EAST JORDAN IRON WORKS NUMBER 8371. MONUMENTS ARE TO BE SET IN A CONCRETE FILLED TWENTY-FOUR (24) INCH DIAMETER CORED HOLE, FLUSH WITH THE TOP OF THE PAVEMENT PER VILLAGE STANDARD.

RDW 12 ALL TRAFFIC CONTROL DEVICES SHALL BE FURNISHED, ERECTED, MAINTAINED, AND REMOVED BY THE CONTRACTOR IN ACCORDANCE WITH THE "OHIO MANUAL OF TRAFFIC CONTROL DEVICES FOR CONSTRUCTION AND MAINTENANCE OPERATIONS" COPIES OF WHICH ARE AVAILABLE FROM THE OHIO DEPARTMENT OF TRANSPORTATION, BUREAU OF TRAFFIC, 25 SOUTH FRONT STREET, COLUMBUS, OHIO 43215.

RDW 13 LANE RESTRICTIONS OR CLOSURES REQUIRED DURING CONSTRUCTION MUST BE APPROVED BY THE VILLAGE OF ASHVILLE ENGINEER AND SERVICE DEPARTMENTS A MINIMUM OF TWO (2) WEEKS PRIOR TO ANY WORK BEING PERFORMED. OTHERWISE, TRAFFIC LANES SHALL BE FULLY OPEN TO TRAFFIC AT ALL TIMES AND INGRESS AND EGRESS SHALL BE MAINTAINED TO PUBLIC AND PRIVATE PROPERTY.

RDW 14 THE CONTRACTOR/DEVELOPER IS RESPONSIBLE FOR THE PROVISION AND SCHEDULING OF PERSONNEL FOR CONCRETE, ASPHALT, AND SOILS TESTING PROCEDURES AS REQUIRED BY THE VILLAGE ENGINEER. TESTING IS TO BE PERFORMED BY REGISTERED TESTING PROCEDURES AS REQUIRED BY THE VILLAGE ENGINEER. TESTING IS TO BE PERFORMED BY A REGISTERED TESTING AGENCY THAT IS APPROVED BY THE VILLAGE ENGINEER.

RDW 15 THE WORK LIMITS SHOWN ON THESE PLANS ARE FOR THE PHYSICAL CONSTRUCTION ONLY. THE INSTALLATION AND OPERATION OF ALL TEMPORARY TRAFFIC CONTROL DEVICES SHALL BE PROVIDED WHETHER INSIDE OR OUTSIDE OF THE WORK LIMITS BY THE CONTRACTOR IN ACCORDANCE WITH THE OHIO MANUAL OF TRAFFIC CONTROL SERVICES FOR CONSTRUCTION AND MAINTENANCE OPERATIONS (CURRENT EDITION). COPIES OF WHICH ARE AVAILABLE FROM THE OHIO DEPARTMENT OF TRANSPORTATION, OFFICE OF TRAFFIC ENGINEERING.

RDW 16 THE TRACKING OF SPILLAGE OF MUD, DIRT OR DEBRIS UPON VILLAGE STREETS IS PROHIBITED AND ANY SUCH OCCURRENCE SHALL BE CLEANED UP IMMEDIATELY BY THE CONTRACTOR.

RDW 17 NO NON-RUBBER TIRE VEHICLE SHALL BE MOVED ON VILLAGE STREETS. EXCEPTIONS MAY BE GRANTED BY AN AUTHORIZED VILLAGE OFFICIAL WHERE SHORT DISTANCES AND SPECIAL CIRCUMSTANCES ARE INVOLVED. GRANTING OF EXCEPTIONS MUST BE IN WRITING AND ANY RESULTING DAMAGE MUST BE REPAIRED TO THE SATISFACTION OF THE VILLAGE.

RDW 18 STEADY BURNING TYPE "C" LIGHTS SHALL BE REQUIRED ON ALL BARRICADES, DRUMS AND SIMILAR TRAFFIC DEVICES IN USE AT NIGHT. CONES ARE NOT PERMITTED TO BE USED FOR NIGHT WORK.

RDW 19 ALL TRAFFIC LANES SHALL BE FULLY OPEN TO TRAFFIC FROM 7:00 A.M. TO 9:00 A.M. AND 4:00 P.M. TO 6:00 P.M., UNLESS OTHERWISE APPROVED BY THE VILLAGE. ONE LANE MAY BE CLOSED TO TRAFFIC DURING WORKING HOURS, DURING SANITARY SEWER BORING OPERATION.

RDW 20 THE PAVEMENT SHALL BE REPLACED BY FIRST REMOVING THE TEMPORARY PAVEMENT DOWN TO THE CLEAN GRANULAR MATERIAL AND REMOVING THE EXISTING PAVEMENT FOR AT LEAST 12 INCHES BEYOND THE TRENCH LIMITS ON EACH SIDE. THE PAVEMENT TO BE REMOVED SHALL BE NEATLY SAWED, NOT MORE THAN 24 HOURS PRIOR TO THE PLACING OF PERMANENT PAVEMENT MATERIALS. THE PERMANENT PAVEMENT MATERIALS AND WORKMANSHIP SHALL BE AT LEAST EQUIVALENT TO THE EXISTING PERMANENT PAVEMENT REPLACED, AS DETERMINED BY THE ENGINEER. AFTER REMOVAL OF THE TEMPORARY PAVEMENT AND SAWING OF THE EXISTING PAVEMENT EDGES. ITEM 407 TACK COAT SHALL BE APPLIED TO THE EXPOSED EXISTING PAVEMENT EDGES, AND TO THE BASE MATERIAL, PRIOR TO THE PLACING OF THE PERMANENT PAVEMENT.

RDW 21 ALL TRENCHES IN THE ROADWAY SHALL BE BACKFILLED OR SECURELY PLATED DURING NON-WORKING HOURS.

RDW 22 IN THE EVENT EXCAVATION FOR THE STREET IS FROM ZERO (0) INCHES TO TWELVE (12) INCHES BELOW WHAT IS CALLED FOR ON THE PLANS THE CONTRACTOR SHALL REPLACE THIS EXCESS EXCAVATED MATERIAL AS DIRECTED BY THE GEOTECHNICAL ENGINEER. ITEM 310 OR 304 AS DIRECTED AND AT NO EXTRA COST TO THE OWNER.

RDW 23 WHERE NECESSARY TO DISTURB EXISTING PAVEMENT OR DRIVES, THE PAVEMENT SHALL BE SAW CUT IN NEAT, STRAIGHT LINES. THE DEPTH OF SAW CUT SHALL BE AT LEAST TWO (2) INCHES.

# SANITARY SEWER NOTES

SAS 1 ALL SEWERS, APPURTENANCES, AND METHODS OF CONSTRUCTIONAND WORKMANSHIP FOR SEWERS AND APPURTENANCES SHOWN ON THESE PLANS SHALL CONFORM TO THE CITY OF COLUMBUS CONSTRUCTION AND MATERIAL SPECIFICATION DIVISION 900 AND APPLICABLE REFERENCES THEREIN, CURRENT ON THE DATE OF THE CONTRACT, UNLESS THE REQUIREMENTS OF SUCH RULES AND REGULATIONS ARE UPGRADED OR MODIFIED BY THE FOLLOWING NOTES OR BY THE CONSTRUCTION DETAILS SE FORTH

SAS 2 SANITARY SEWER LEAKAGE TESTING; LEAKAGE TESTING: LEAKAGE TEST SHALL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF ITEM 901.20 AND SHALL INCLUDE MAIN SEWER, MANHOLES AND SERVICE CONNECTIONS DURING THE CONSTRUCTION OF THE SEWER AND MANHOLES GROUND WATER LEVELS SHALL BE OBSERVED AND REPORTED IN A SUITABLE LOG. GROUND WATER OBSERVATION PIPES SHALL BE INSTALLED IN MANHOLES AS FOLLOWS FOR THE PURPOSE OF MONITORING GROUND WATER LEVELS PREVAILING OVER THE PROJECT AT THE TIME OF LEAKAGE TESTING. THESE MANHOLES ARE MHS 2, 5, 7, 10, 13, 14, 17 AND 19.

SAS 3 THE CONTRACTOR'S SPECIFIC ATTENTION IS DIRECTED TO THE REQUIREMENTS OF EITHER THE INFILTRATION OR EXFILTRATION AS SPECIFIED BY THE VILLAGE OF ASHVILLE. LEAKAGE THROUGH THE JOINTS OF THE SEWER SHALL NOT EXCEED THE FOLLOWING ALLOWABLE LIMITS: ONE HUNDRED (100) GALLONS PER INCH OF TRIBUTARY SEWER DIAMETER PER TWENTY FOUR (24) HOURS PER MILE OF LENGTH OR THE COMPUTED EQUIVALENT FOR SHORTER LENGTHS AND SHORTER PERIODS OF TIME. ALL SANITARY SEWERS AND SERVICES SHALL BE TESTED. ALL SANITARY SEWERS SHALL BE SUBJECT TO AND PASS THE INFILTRATION OR EXFILTRATION TEST PRIOR TO ACCEPTANCE. AN AIR TEST IS ACCEPTABLE TO THE VILLAGE OF ASHVILLE. THIS AIR TEST SHALL BE PERFORMED ACCORDING TO THE CURRENT REGULATIONS OF THE VILLAGE'S ENGINEERING DEPARTMENT.

SAS 4 CLEAN WATER CONNECTIONS INCLUDING ROOF DRAINS, FOUNDATION DRAINS, SUMPS, ETC. ARE PROHIBITED FROM BEING CONNECTED TO THE SANITARY SEWER.

SAS 5 MATERIAL: UNLESS OTHERWISE INDICATED ON THE PLANS, SEWERS AND SERVICES ARE TO BE SUPPLIED WITH MATERIAL CONFORMING TO ITEM 901 CMSC.

(1) POLYVINYL CHLORIDE (PVC) PLASTIC PIPE: ITEM 720.08 PIPE SHALL CONFORM TO ASTM D-3034 SDR 35 FOR SIZES 6", 8", 10", 12" AND 15". FITTINGS SHALL ALSO CONFORM TO ASTM F-1336. (2) POLYVINYL CHLORIDE (PVC) LARGE DIAMETER PLASTIC PIPE: ITEM 720.08. THE PIPES AND FITTINGS SHALL CONFORM TO ASTM F-679 FOR SIZES 18" THROUGH 36".

SAS 6 PIPES FOR ALL 6" SERVICES SHALL BE PVC SEWER PIPE CONFORMING TO REQUIREMENTS OF ASTM D-3034, SDR 35. THESE SERVICES ARE ALS SUBJECT TO LEAK TESTING. SERVICES EXTESNIONS SHALL BE INSTALLED AT A MINIMUM GRADE OF 1/4" PER FOOT AND SHALL BE CONSTRUCTED AT THE TIME OF CONSTRUCTING THE MAIN SEWER, UNLESS OTHERWISE DIRECTED BY THE ENGINEER.

H **IREE** Щ ASH H STR 

≥回

JOB NO. 1009 DRAWN BY DESIGN BY

CMT

SHEET

CHECKED BY

# SANITARY SEWER NOTES (CONTINUED)

SAS 7 THE MINIMUM REQUIREMENT FOR SEWER PIPE ON THIS PROJECT SHALL BE SDR35, ASTM D3034 POLYVINYL CHLORIDE (PVC) SEWER PIPE WITH ASTM C1784 CELL CLASSIFICATION OF 12454 B OR 12454 C, UNLESS OTHERWISE SHOWN ON THE PLANS.

SAS 8 ALL PVC PIPE SHALL BE DEFLECTION TESTED THIRTY (30) DAYS OR MORE AFTER THE TRENCH HAS BEEN BACKFILLED TO FINISHED GRADE. THE TESTING SHALL BE DONE IN ACCORDANCE WITH ITEM 901.21 CMSC. A RIGID MANDREL PROVIDED BY THE CONSTRACTOR AND APPROVED BY THE ENGINEER SHALL BE USED FOR THE TESTING. NO MECHANICAL PULLING DEVICES SHALL BE USED. PIPE DEFLECTION SHALL NOT EXCEED FIVE (5) PERCENT. AN ACCURATE LOG OF THE SEWER INSTALLATION SEGMENTS AND DATES SHALL BE KEPT BY THE CONTRACTOR.

SAS 9 6'-0" LONG CLAY DAMS ARE TO BE INSTALLED ALONG MAIN LINE SEWERS IN ACCORDANCE WITH ITEM 901.11 CMCS AT HALF THE DISTANCE BETWEEN EACH PAIR OF MANHOLES. BUT NO CLOSER THAN TEN (10) FEET FROM A LATERAL SERVICE, COST TO BE INCLUDED WITH CARIOUS SEWER ITEMS.

SAS 10 6'-0" LONG CLAY DAMS ARE TO BE INSTALLED ON ALL SANITARY LATERAL SEWERS BUT NO CLOSER THAN FIVE (5) FEET FROM THE END OF THE SERVICE. DAMS ARE TO BE INSTALLED BY SITE UTILITY CONTRACTOR WITH THE COST TO BE INCLUDED WITH VARIOUS SEWER ITEMS.

SAS 11 PUBLIC SANITARY MANHOLE COVERS ARE TO BE EAST JORDAN IRON WORKS NO. 1660-A2 OR EQUIVALENT AND EMBOSSED "VILLAGE OF ASHVILLE SANITARY SEWER".

SAS 12 ALL SANITARY MANHOLES AND LATERAL SERVICES ARE TO BE MARKED WITH A 4"X4"X10'-0" PRESSURE TREATED WOOD POST WITH 4'-0" PROJECTING ABOVE THE FINISHED GRADE AND WITH THE TOP 1'-0" PAINTED GREEN ON FOUR (4) SIDES. ADDITIONALLY A 2"X2" HARDWOOD WYE POLE IS TO BE WIRED TO THE BASE OF EACH 4"X4" POLE AND EXTENDED DOWN TO THE END OF EACH LATERAL SERVICE. COST TO BE INCLUDED IN THE VARIOUS ITEMS.

SAS 13 WHERE THE COVER TO FINISHED GRADE OVER A SANITARY WYE IS IN EXCESS OF TWELVE (12) FEET, A LENGTH OF RISER PIPE AND A FORTY-FIVE (45) DEGREE BEND SHALL BE INSTALLED ALONG WITH A MINIMUM OF ONE WHOLE LENGTH OF SIX (6) INCH PIPE SUCH THAT THE END OF THE SERVICE WILL BE TEN (10) FEET BELOW GRADE. ALL SANITARY LINES AND SERVICES ARE TO BE DESIGNED AND INSTALLED SO AS TO PROVIDE BASEMENT SERVICE.

SAS 14 WHERE THE SANITARY SEWER CROSSES UNDER A PROPOSED STORM SEWER OR WATERLINE THE TRENCH SHALL BE BACKFILLED TO THE BOTTOM OF THE PROPOSED STORM SEWER OR WATERLINE WITH COMPACTED GRANULAR MATERIAL AS PER ITEM 912, FOR A LENGTH OF TWENTY (20) LINEAR FEET CENTERED ON THE STORM SEWER OR WATERLINE. THE COST OF THIS WORK IS TO BE INCLUDED IN THE PRICE BID FOR THE VARIOUS SEWER ITEMS.

SAS 15 PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL VERIFY MANHOLE CONSTRUCTION AND TOP-OF-CASTING ELEVATION. MANHOLES SHALL BE BUILT OR ADJUSTED SO THE TOPS CONFORM TO THE ELEVATIONS SHOWN ON THESE PLANS. ALL MANHOLE CASTING ADJUSTMENTS SHALL BE ACCOMPLISHED WITH PRE-CAST CONCRETE ADJUSTMENT RINGS.

SAS 16 ALL PIPES SHALL BE INSTALLED WITH STONE OR GRAVEL BEDDING AS SHOWN IN THE STANDARD DRAWINGS.

SAS 17 SANITARY TRENCH DETAILS SHALL BE IN ACCORDANCE WITH THE CITY OF COLUMBUS STANDARD DRAWINGS AA-S149 UNLESS OTHERWISE INDICATED BY VILLAGE OF ASHVILLE STANDARD DRAWINGS. ALL PIPES SHALL BE INSTALLED WITH STONE OR GRAVEL TYPE BEDDING.

SAS 18 TEMPORARY BULKHEADS SHALL BE PLACES WHERE INDICATED ON THE PLANS AND SHALL REMAIN IN PLACE UNTIL REMOVAL IS DIRECTED BY THE VILLAGE ENGINEER. BULKHEADS SHALL BE INSTALLED IN MANHOLE #2 ON 12" (E) AND ON MANHOLE #5 ON 8" (N) AND 12" (E).

SAS 19 SANITARY LATERALS INSTALLED IN A COMMON TRENCH ARE TO BE INSTALLED WITH A MINIMUM 2'-0" CENTER TO CENTER SEPARATION OF PIPES IN A 4'-0" MINIMUM TRENCH WITH A 1'-0" MINIMUM BEDDING AROUND PIPES. PIPE ENDS ARE TO BE FLARED TO A MINIMUM 10'-0" CENTER TO CENTER SEPARATION OF PIPES AT 5'-0" FROM THE PROPERTY LINE RIGHT-OF-WAY.

SAS 20 A PERMANENT FLEXIBLE WATER JOINT SEALANT BETWEEN THE TOPS OF SANITARY MANHOLES AND MANHOLE CASTINGS SHALL BE INSTALLED. SEALANT TO BE "CONSEAL" AS MANUFACTURED BY CONCRETE SEALANTS, INC. NEW CARLISLE, OHIO OR APPROVED EQUAL.

SAS 21 EACH MANHOLE SHALL BE PROVIDED WITH A "CHIMNEY SEAL" CONSISTING OF A TRIPLE PLEATED RUBBER SLEEVE HAVING A MINIMUM THICKNESS OF 3/16 INCH. A MINIMUM UNEXPANDED VERTICAL HEIGHT OF EIGHT (8) INCHES, CAPABLE OF EXPANDING NOT LESS THAN TWO (2) INCHES VERTICALLY WHEN INSTALLED, EQUIPPED WITH SIXTEEN (16) GAUGE BY 1-3/4 INCH WIDE A.S.T.M. STAINLESS STEEL TYPE 304 EXPANSION BANDS, THE ENTIRE UNIT AS MANUFACTURED BY CRETEX SPECIALTY PRODUCTS OR APPROVED EQUAL.

SAS 22 NO FLOW MAY BE DIVERTED INTO THE NEW OR EXISTING SEWER UNTIL THEY HAVE BEEN INSPECTED, TESTED. AND APPROVED FOR USE. WRITTEN APPROVAL FOR SUCH USE SHALL BE OBTAINED FROM THE VILLAGE OF ASHVILLE.

# SANITARY AND STORM SEWER NOTES

STM/SAS 1 ROOF DRAINS. FOUNDATION DRAINS AND OTHER CLEAN WATER CONNECTIONS TO THE SANITARY SEWER SYSTEM ARE PROHIBITED ON THIS PROJECT.

STM/SAS 2 ALL SANITARY SEWERS CONSTRUCTED UNDER THIS PLAN SHALL MEET THE REQUIREMENTS OF THE VILLAGE OF ASHVILLE, UNLESS OTHERWISE NOTED.

STM/SAS 3 THE CONSTRUCTION OF NEW SANITARY SEWERS OR WATERLINES SHALL NOT BEGIN UNTIL THE VILLAGE RECEIVES AN APPROVED AND CURRENT OHIO ENVIRONMENTAL PROTECTION AGENCY PERMIT TO INSTALL (PTI), OR A LETTER OF ACCEPTANCE.

STM/SAS 4. THERE SHALL BE NO SANITARY SEWER INSTALLED IN REAR OR SIDE LOT EASEMENTS WITHOUT PRIOR WRITTEN APPROVAL FROM THE VILLAGE OF ASHVILLE WASTEWATER SUPERINTENDENT.

STM/SAS 5 THE MINIMUM REQUIREMENTS FOR SANITARY SEWER PIPE SHALL BE PVC SEWER PIPE ASTM D-3034, SDR 35 AND ASTM F-679.

STM/SAS 6 THE MINIMUM REQUIREMENT FOR STORM SEWER PIPE SHALL BE: 8" THROUGH 36" HIGH DENSITY POLYETHYLENE N-12 OR EQUAL HIGH DENSITY POLYETHYLENE PIPE WITH SMOOTH INTERIOR WAIL. STORM DRAINS LARGER THAN 36" SHALL MEET THE REQUIREMENTS OF AASHTO M-294-S. REINFORCED CONCRETE RCP MAY BE SPECIFIED BY THE ENGINEER WHEN THEY DEEM NECESSARY.

STM/SAS 7 ALL TRENCH BACKFILL SHALL BE COMPACTED BACKFILL AS PER CMSC ITEM 911. THE COST OF OIL COMPACTED BACKFILL SHALL BE INCLUDED IN THE PRICE BID FOR FURNISHING AND INSTALLING PIPE. THE CONTRACTOR IS HEREBY NOTIFIED THAT THE CMSC FOR ASHVILLE REQUIRES THE USE OF NUMBER 57 CRUSHED LIMESTONE ROUND GRAVEL FOR BEDDING OF SANITARY PIPE.

### SANITARY AND STORM SEWER NOTES

STM/SAS 8 IN ADDITION TO THE REQUIREMENTS OF CMSC ITEM 901.08 AS IT REFERS TO COMPACTED BACKFILL, THERE MAY BE AREAS ON THE PLANS WITH THE LIMITS INDICATED ON THE PROFILE VIEW OF THE SEWER AS "COMPACTED GRANULAR BACKFILL". THESE AREAS WILL BE COMPACTED TO MEET THE REQUIREMENTS OF CMSC ITEM 912.03. PAYMENT FOR THE COMPACTION OF BACKFILL WITHIN THESE AREAS SHALL BE INCLUDED IN THE PRICE BID FOR FURNISHING AND INSTALLING PIPE.

STM/SAS 9 ALL BEDDING OF SANITARY SEWER PIPE SHALL CONFORM TO THE TYPICAL TRENCH DETAIL.

STM/SAS 10 THE CONTRACTOR'S SPECIFIC ATTENTION IS DIRECTED TO THE REQUIREMENTS OF THE LEAKAGE TEST. ALL SANITARY SEWERS SHALL BE TESTED FOR LEAKAGE IN ACCORDANCE WITH 901.20 OF THE CITY OF COLUMBUS CONSTRUCTION AND MATERIAL SPECIFICATIONS. THIS IS AN EXFIITRATION WATER TEST. AN AIR TEST IS PERMITTED AS DIRECTED BY THE VILLAGE OF ASHVILLE. AN INFILTRATION TEST MAY BE REQUIRED IN AREAS OF HIGH GROUNDWATER.

STM/SAS 11 PIPE FOR ALL SIX (6) INCH HOUSE SERVICES SHALL BE PVC SEWER PIPE, ASTM D-3034, SDR 35. ALL SERVICE EXTENSIONS SHALL BE LAID AT A 'MINIMUM GRADE OF TWO (2) PERCENT AND SHALL BE CONSTRUCTED AT THE TIME OF CONSTRUCTION OF THE MAIN SEWER, UNLESS OTHERWISE DIRECTED BY THE VILLAGE ENGINEER.

STM/SAS 12 CONNECTIONS BETWEEN EXISTING AND PROPOSED SERVICE LINES SHALL BE COMPLETED USING A FOUR (4) INCH OR SIX (6) INCH FERNCO, INC. DONUT OR BOOT.

STM/SAS 13 A WYE POLE MADE OF 4" BY 4" LUMBER SHALL BE FURNISHED AND PLACED AT ALL WYE BRANCHES AND AT THE END OF EXTENDED SERVICE. THE COST OF THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR THE SEWER ITEMS.

STM/SAS 14 ALL SANITARY SEWER LINES INSTALLED USING PVC PIPE WILL BE. SUBJECT TO DEFLECTION TESTING BY PULLING AN APPROVED MANDREL EQUAL IN DIAMETER TO 95% OF THE PIPE DIAMETER THROUGH THE PIPE NO LESS THAN (30) DAYS AFTER THE PIPE IS BACKFILLED.

STM/SAS 15 THE WYE LOCATIONS SHOWN ON THE PLANS ORE APPROXIMATE AND SHALL BE FIELD LOCATED DURING CONSTRUCTION TO SERVE THE INDIVIDUAL STRUCTURES.

STM/SAS 16 MANHOLE COVERS FOR SANITARY SEWERS SHALL CONFORM TO VILLAGE OF ASHVILLE STANDARD DRAWINGS.

STM/SAS 17 MANHOLE TOPS SHALL BE BUILT OR SUBSEQUENTLY ADJUSTED TO MEET SURFACE GRADES ESTABLISHED FOR THE DEVELOPMENT. COST OF THIS WORK IS TO BE INCLUDED IN THE PRICE BID FOR THE **VARIOUS SEWER ITEMS** 

STM/SAS 18 ALL SANITARY SEWER LINES SHALL END WITH MANHOLES.

STM/SAS 19 ALL NEW SANITARY SEWER AND STORM DRAIN MANHOLES INSTALLED IN THE VILLAGE OF ASHVILLE SANITARY SEWER AND STORM DRAIN SYSTEMS SHALL BE AS FOLLOWS:

- a. PRE-CAST CONCRETE
- b. FOUR (4) FOOT DIAMETER, MINIMUM
- c. INSTALLED WITH FORMED CHANNELS

STM/SAS 20 ALL NEW SANITARY SEWER MANHOLES AND EXISTING SANITARY MANHOLES ADJUSTED TO GRADE SHALL BE CONSTRUCTED WITH CHIMNEY SEALS AND DISH IN ACCORDANCE WITH VILLAGE OF ` ASHVILLE SPECIFICATIONS.

STM/SAS 21 ALL NEW MANHOLES AND EXISTING MANHOLES ADJUSTED TO GRADE SHALL HAVE CONCRETE COLLARS.

STM/SAS 22 SANITARY SEWER--MANHOLE CONNECTIONS: THE SANITARY SEWER PIPE TO MANHOLE CONNECTIONS SHALL BE OF A FLEXIBLE WATERTIGHT JOINT OF APPROVED MANUFACTURE. THE JOINT MAY BE OF THE FOLLOWING DESIGN (A) RUBBER SLEEVE WITH STAINLESS STEEL BANDING, (B) RUBBER GASKET COMPRESSION, OR (C) RUBBER GASKET EXPANSION.

STM/SAS 23 MANHOLE LOCATIONS: THE STATION AND OFFSET OF THE MANHOLES SHOWN ON THE PLANS ARE TO THE CENTER OF THE MANHOLE BASE.

STM/SAS 24 THE MAXIMUM TRENCH WIDTH SHALL NOT BE GREATER THAN THE OUTSIDE DIAMETER OF THE PIPE PLUS TWO (2) FEET.

STM/SAS 25 THE CONTRACTOR SHALL MAKE PROVISIONS TO MAINTAIN FLOWS IN THE EXISTING SEWER AT ALL TIMES - DURING CONSTRUCTION METHODS FOR MAINTAINING

STM/SAS 26 ALL SANITARY SEWERS SHALL BE RECORDED IN DVD FORMAT AFTER CONSTRUCTION PRIOR TO ACCEPTANCE OF THE SEWERS BY THE VILLAGE OF ASHVILLE. THE DVD SHALL REMAIN THE PROPERTY OF THE VILLAGE OF ASHVILLE. THE DVD SHALL CLEARLY IDENTIFY THE LOCATION OF THE CAMERA WITHIN THE SEWER, DATE AND TIME OF THE DVD AND BE OF SUFFICIENT QUALITY TO DETERMINE THE CONDITIONS OF THE SANITARY SEWERS. AN ADDITIONAL DVD SHALL BE PERFORMED JUST PRIOR TO THE EXPIRATION OF THE ONE (1) YEAR WARRANTY PERIOD.

STM/SAS 27 THE MAXIMUM VELOCITY IN ANY NEW SANITARY SEWER SHALL NOT EXCEED TEN FEET PER SECOND (10 FPS).

STM/SAS 28 TESTING OF LATERAL CONNECTIONS SHALL BE ADHERED TO.

STM/SAS 29 THE CONTRACTOR SHALL MAKE PROVISIONS TO MAINTAIN FLOWS IN THE EXISTING SEWER AT ALL TIMES - DURING CONSTRUCTION METHODS FOR MAINTAINING FLOWS SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION. AT NO TIME WILL SANITARY SEWAGE BE ALLOWED TO DISCHARGE TO ANY RIVER OR STREAM NOR SPILL OUT ON THE GROUND. APPROVAL OF PLANS BY THE ENGINEER TO MAINTAIN FLOWS SHALL NOT RELIEVE THE CONTRACTOR OF ANY RESPONSIBILITY TO ADEQUATELY PROVIDE FOR ALL FLOWS. THE CONTRACTOR SHALL BE AWARE THAT THE EXISTING SEWERS MAY BE OPERATING UNDER PRESSURE (HEAD) DURING TIMES OF RAINFALL: THEREFORE THE CONTRACTOR SHALL EXERCISE CAUTION WHEN WORKING ON THESE SEWERS. PAYMENT FOR THIS WORK SHALL BE INCLUDED IN THE ITEM BID FOR FURNISHING AND INSTALLING PIPE.

STM/SAS 30 THE CONTRACTOR SHALL SUBMIT TO THE DESIGN ENGINEER AND THE VILLAGE ENGINEER FOR HIS OR HER REVIEW, FIVE COPIES OF SHOP DRAWINGS FOR ALL MATERIALS, STRUCTURES, GRADATION CERTIFICATIONS AND EQUIPMENT BEFORE ANY OF THE SAID MATERIALS, STRUCTURES OR EQUIPMENT IS ORDERED. THE OWNER NOR VILLAGE BARE ANY RESPONSIBILITY TO ACCEPT ANY OF THE ABOVE MENTIONED ITEMS WITHOUT A COMPLETED REVIEW OF SAID SHOP DRAWINGS. SHOP DRAWINGS SHALL BE APPROVED BY THE DESIGN ENGINEER PRIOR TO SUBMITTAL TO THE VILLAGE ENGINEER. THESE DOCUMENTS SHALL BE BOUND AND INDEXED WITH NUMBERED SHEETS FOR EACH ITEM OR PAGES NUMBERED THROUGHOUT.

STM/SAS 31 THE MINIMUM CLEARANCE BETWEEN SANITARY AND WATER MAINS SHALL BE TEN (10) FEET HORIZONTAL OR ONE(1) FOOT SIX (6) INCHES VERTICAL OUTSIDE OF PIPE TO OUTSIDE OF PIPE.

# STORMWATER NOTES

STM 1 THE MINIMUM REQUIREMENTS FOR STORM SEWER PIPE WITH THE VILLAGE RIGHT-OF-WAY OR EASEMENTS SHALL BE REINFORCED CONCRETE PIPE ASTM C655 OR ASTM C76 AND NON-REINFORCED CONCRETE PIPE ASTM C14 OR CORRUGATED POLYETHYLENE SMOOTH LINES M-294, TYPES S, AS PER OHIO DEPARTMENT OF TRANSPORTATION CONSTRUCTION AND MATERIAL SPECIFICATIONS ITEM 707.

STM 2 FLEXIBLE STORM SEWERS ARE SUBJECT TO MANDREL TESTING AND/OR VIDEO INSPECTION AS DIRECTED BY THE VILLAGE ENGINEER. TESTING SHALL BE PERFORMED NO SOONER THAN THIRTY (30) DAYS AFTER THE PIPE TRENCH HAS BEEN BACKFILLED AND ALL ROADWAY AND SITE FILLS OVER THE STORM LINES HAVE BEEN CONSTRUCTED. MAXIMUM DEFLECTION SHALL NOT EXCEED 7.5% OF THE BASE INSIDE DIAMETER. COST OF TESTING SHALL BE AT THE EXPENSE OF THE CONTRACTOR.

STM 3 ALL STORM MANHOLES SHALL BE MARKED WITH A 4" X 4" X 10' - 0" PRESSURE TREATED WOODEN POST PROJECTING 4' - 0" ABOVE THE FINISHED GRADE AND WITH THE TOP 1' - 0" PAINTED GREEN ON FOUR

STM 4 THE COST OF ANY DEWATERING OPERATIONS REQUIRED FOR THE CONSTRUCTION OF THE STORM SEWER SHALL BE INCLUDED IN THE PRICE BID FOR THE VARIOUS SEWER ITEMS.

STM 5 THE COST OF ANY ROCK EXCAVATION SHALL BE INCLUDED IN THE PRICE BID FOR THE STORM SEWER. THE BIDDER SHALL DETERMINE IF ANY ROCK EXCAVATION WILL BE REQUIRED AND ADJUST THEIR BIDS ACCORDINGLY.

STM 6 THE FLOW IN ALL SEWERS, DRAINS, AND WATERCOURSES ENCOUNTERED SHALL BE MAINTAINED BY THE CONTRACTOR AT THEIR OWN EXPENSE AND WHENEVER SUCH WATERCOURSES AND DRAINS ARE DISTURBED OR DESTROYED DURING THE PROSECUTION OF THE WORK, THEY SHALL BE RESTORED BY THE CONTRACTOR AT HIS OWN EXPENSE TO A CONDITION SATISFACTORY TO THE ENGINEER.

STM 7 ALL MAJOR FLOOD ROUTES AND DETENTION BASINS ARE TO BE SURVEYED BY A REGISTERED SURVEYOR TO VERIFY CONFORMANCE TO THE APPROVED GRADING PLAN. COST OF THIS WORK SHALL BE AT THE EXPENSE OF THE CONTRACTOR.

STM 8 EROSION CONTROL MEASURES ARE TO BE INSTALLED BY THE CONTRACTOR DURING CONSTRUCTION TO PROTECT CATCH BASINS AND CURB INLETS FROM SILT, MUD, AND DEBRIS.

STM 9 ALL DRAINAGE FLOOD ROUTES, SWALES, AND DITCHES ARE TO BE DESIGNED AND GRADED WITH A MINIMUM FLOW LINE GRADE OF TWO (2) PERCENT, AND A MAXIMUM SIDE SLOPE OF 4:1.

STM 10 ALL CATCH BASINS, MANHOLES, AND CURB INLETS SHALL HAVE CONCRETE CHANNELS POURED IN PLACE TO ASSURE POSITIVE DRAINAGE THROUGH THESE STRUCTURES.

STM 11 PUBLIC STORM SEWER MANHOLE LIDS ARE TO BE EAST JORDAN IRON WORKS NUMBER 1660 - A2 OR EQUIVALENT AND EMBOSSED "VILLAGE OF ASHVILLE STORM SEWER".

STM 12 STORM SEWER CURB INLETS ARE TO BE ADJUSTED WITHIN 1/2" OF PLAN ELEVATION USING STEEL SHIMS.

STM 13 PRE-CAST RINGS ARE TO BE USED FOR ALL FINAL ADJUSTMENTS OF MANHOLE CASTINGS. STORM MANHOLE TOP OF CASTINGS SHOULD BE SET AT 1 - ½" ABOVE FINISHED GRADE.

STM 14 OPENINGS SHALL BE PROVIDED IN DRAINAGE STRUCTURES TO ACCOMMODATE UNDER DRAIN OUTLETS. UNDER DRAINS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH DETAILS GIVEN IN THE PLANS.

# WATER MAIN/LINE NOTES

WML 1 ALL WATERLINE SERVICE SADDLES SHALL BE DOUBLE BOLT STAINLESS STEEL STYLE 306 AS MANUFACTURED BY ROMAC, OR EQUAL.

WML 2 LOCATION, SUPPORT, PROTECTION AND RESTORATION OF ALL WATER LINES, SERVICES AND APPURTENANCES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR SHALL SUBMIT HIS DETAILS AND METHODS OF SUPPORTING THE WATER LINES ACROSS THE SEWER TRENCH TO THE ENGINEER FOR APPROVAL BY THE WATER DEPARTMENT. SUPPORT METHOD AND DETAIL APPROVAL SHALL BE SECURED PRIOR TO THE COMMENCEMENT OF EXCAVATION OPERATIONS.

WML 3 WATER MAINS SHALL, WHERE POSSIBLE, BE DEFLECTED AROUND STRUCTURES WITHOUT THE USE OF SPECIAL FITTINGS AND WITHOUT EXCEEDING THE MANUFACTURER'S ALLOWABLE DEFLECTION.

WML 4 THE CONTRACTOR SHALL HAND SWAB ALL PIPE AND FITTINGS THAT ARE NOT OTHERWISE DISINFECTED. THE AMOUNT OF CHLORINE TO BE USED DURING HAND SWABBING OPERATIONS SHALL BE DETERMINED BY THE VILLAGE OF ASHVILLE, WATER DEPARTMENT.

WML 5 ANY TESTING PERFORMED AGAINST EXISTING VALVES SHALL BE DONE AT THE CONTRACTOR'S RISK AND IN STRICT COMPLIANCE WITH THE REQUIREMENTS OF THE ENGINEER. IF SATISFACTORY TEST RESULTS CANNOT BE OBTAINED AGAINST AN EXISTING VALVE. THE NEW LINE SHALL BE DISCONNECTED FROM THE EXISTING LINE, PLUGGED AND RE-TESTED. DAMAGE CAUSED TO EXISTING LINES AND VALVES SHALL BE REPAIRED BY THE CONTRACTOR AT HIS OWN EXPENSE.

WML 6 ALL COST TO PLUG AND BLOCK THE ENDS OF WATER MAINS AT LOCATION SHOWN IN THE PLANS SHALL BE INCLUDED IN THE PRICE BID FOR PIPE.

WML 7 WATER SERVICE BOXES SHALL BE LOCATED 6" TO 12" FROM THE ROADWAY RIGHT-OF-WAY LINE, UNLESS OTHERWISE AUTHORIZED BY THE VILLAGE ENGINEER.

WML 8 A DETECTABLE UNDERGROUND UTILITY MARKING TAPE SHALL BE INSTALLED APPROXIMATELY 18" BELOW GRADE. THIS TAPE SHALL CONSIST OF A MINIMUM 5 MIL. OVERALL THICKNESS. WITH A SOLID ALUMINUM FOIL CORE, WITH, A 2 MIL. CLEAR FILM REVERSE PRINT LAMINATED TO AN ALUMINUM FOIL TO 2 MIL. CLEAR FILM, MAKING THE FILM PERMANENTLY PRINTED. COLOR CODE SHALL BE BLUE INDICATING WATER AND ASSOCIATED LINES. THE TAPE SHALL BE MANUFACTURED TO WITHSTAND ALKALINE, ACIDIC AND NEUTRAL SOIL CONDITIONS. ANY DIRECTIONAL BORED PIPE SHALL HAVE A NO. 6 BRAIDED WIRE, INSTALLED WITH THE PIPE. COST SHALL BE INCLUDED WITH THE PRICE OF PIPE. NO SEPARATE PAYMENT WILL BE MADE.

WML 9 THE CONTRACTOR SHALL SUBMIT TO THE VILLAGE ENGINEER FOR REVIEW, FIVE COPIES OF SHOP DRAWINGS FOR ALL MATERIALS, STRUCTURES, GRADATION CERTIFICATIONS AND EQUIPMENT BEFORE ANY OF THE SAID MATERIALS, STRUCTURES AND EQUIPMENT IS ORDERED. THE OWNER NOR THE VILLAGE OF ASHVILLE BEAR ANY RESPONSIBILITY TO ACCEPT ANY OF THE ABOVE-MENTIONED ITEMS WITHOUT A COMPLETE REVIEW OF SAID SHOP DRAWINGS. THE SHOP DRAWINGS SHALL BE APPROVED BY THE ENGINEER PRIOR TO SUBMISSION TO THE VILLAGE, THESE DOCUMENTS SHALL BE BOUND INTO A FOLDER WITH EITHER AN INDEX WITH # OF SHEETS FOR EACH ITEM OR PAGES IDENTIFIED THROUGHOUT.

WML 10 ALL WATER PIPES AND FITTINGS, AND METHODS OF CONSTRUCTION AND WORKMANSHIP FOR WATER LINES AND APPURTENANCES SHOWN IN THESE PLANS SHOULD CONFORM TO THE CITY OF COLUMBUS CONSTRUCTION AND MATERIAL SPECIFICATIONS, DIVISION 800 AND APPLICABLE REFERENCES THEREIN, CURRENT ON THE DATE OF CONTRACT, UNLESS THE REQUIREMENTS OF SUCH RULES AND REGULATIONS ARE UPGRADED OR MODIFIED BY THE FOLLOWING NOTES OR BY THE CONSTRUCTION DETAILS SET FORTH HEREIN.

WML 11 WORK REQUIRING THE SHUTDOWN OF EXISTING WATER MAINS IS TO BE COORDINATED. WITH THE VILLAGE OF ASHVILLE WATER DEPARTMENT FORTY-EIGHT (48) HOURS PRIOR TO THE SCHEDULED. WORK BEING PERFORMED. ALL EFFECTED CUSTOMERS SHALL BE NOTIFIED BY THE CONTRACTOR AT LEAST TWENTY-FOUR (24) HOURS PRIOR TO THE SHUT DOWN.

WML 12 WATER MAINS SHALL BE DUCTILE IRON PIPE DESIGNED IN ACCORDANCE WITH THE LATEST REVISIONS OF A.N.S.I./A.W.W.A. C150/A21.50 FOR A MINIMUM 150 PSI (OR PROJECT REQUIREMENTS, WHICHEVER IS GREATER) RATED WORKING PRESSURE PLUS A 100 PSI MINIMUM SURGE ALLOWANCE; A 2 TO 1 FACTOR OR SAFETY ON THE SUM OF WORKING PRESSURE PLUS SURGE PRESSURE.

WATER MAIN/LINE NOTES (CONTINUED)

WML 13 WATER MAINS SHALL BE DUCTILE IRON PIPE, CLASS 52 (AWWA C151) WITH CEMENT MORTAR LINING AND SEAL COATING (AWWAC104) IN ACCORDANCE WITH VILLAGE SPECIFICATIONS. JOINTS SHALL BE RUBBER GASKET PUSH-ON MECHANICAL (AWWA C111). WATER MAIN FITTINGS SHALL BE OF DUCTILE IRON WITH CEMENT MORTAR LINING AND SEAL COATING WITH MECHANICAL JOINTS AND SHALL CONFORM TO **AWWA C153.** 

WML 14 DUCTILE IRON PIPE SHALL BE MANUFACTURED IN THE U.S.A. IN ACCORDANCE WITH THE LATEST REVISION OF A.N.S.I. /A.W.W.A. C151/A21.51. EACH PIPE SHALL BE SUBJECT TO A HYDROSTATIC PRESSURE TEST OF AT LEAST 500 PSI AT THE POINT OF MANUFACTURED.

WML 15 PIPE SHALL HAVE STANDARD ASPHALTIC COATING ON THE EXTERIOR PIPE SHALL ALSO HAVE A CEMENT MORTAR ON THE INTERIOR IN ACCORDANCE WITH A.N.S.I. /A.W.W.A. C104/A21.4 OF THE LATEST REVISION.

WML 16 THE CLASS OR NOMINAL THICKNESS. NET WEIGHT WITHOUT LINING. AND CASTING PERIOD SHALL BE CLEARLY MARKED ON EACH LENGTH OF PIPE. ADDITIONALLY, THE MANUFACTURE'S MARK, COUNTRY WHERE CAST, YEAR IN WHICH THE PIPE WAS PRODUCED, AND LETTERS "DI" OR "DUCTILE" SHALL BE CAST OR STAMPED ON THE PIPE.

WML 17 PVC PLASTIC PIPE, A.W.W.A. C900 DR 18 FOR SIZES 4" TO 12" AND A.W.W.A. C905 DR 18 FOR SIZES 14" AND ABOVE MAY BE USED ONLY WHEN APPROVED BY THE VILLAGE OF ASHVILLE.

WML 18 ALL PIPING TWO (2") INCHES OR LESS IN DIAMETER BETWEEN THE WATER MAIN AND THE CONTROL VALVE OR THE METER PIT SHALL BE TYPE K, SOFT TEMPERED, COPPER TUBING CONFORMING IN ALL RESPECTS TO A.S.T.M. 888. FITTINGS SHALL BE HIGH QUALITY COPPER BRASS WITH AAWA APPROVED COMPRESSION TYPE JOINTS. IN GENERAL, THERE WILL BE NO FITTINGS PERMITTED BETWEEN THE WATER MAIN CONNECTION AND THE CONTROL VALVE.

WML 19 DEAD END WATER LINES SHALL TERMINATE WITH A FIRE HYDRANT AND A WATCH VALVE OR TWO ¾ INCH WATER SERVICE FOLLOWED BY SUFFICIENT LENGTH OF WATER LINE TO RESTRAIN THE VALVE AND SHALL BE FOLLOWED BY A MAIN LINE VALVE AND AN ADDITIONAL SECTION OF WATER LINED PLUGGED AND **BLOCKED PER THE "STANDARD DRAWINGS"** 

WML 20 WATERLINES SHALL BE INSTALLED WITH A MINIMUM OF FOUR (4) FEET OF COVER MEASURED FOR THE FINISHED GRADE TO THE TOP OF THE WATER MAIN.

WML 21 ALL MAIN LINE VALVES, HYDRANT WATCH VALVES, CURB BOXES AND DEAD END LINES ARE TO BE MARKED WTIH A 4"X4"8'0" OR 10'-0" PRESSURE TREATED WOOD POST WITH 4'-0" PROJECTING ABOVE THE FINISH GRADE AND THE TOP 1'-0" POINTED BLUE ON ALL FOUR (4) SIDES.

WML 22 THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE HORIZONTAL AND VERTICAL DEFLECTIONS OR BENDS OF THE WATER LINES IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. DEFLECT WATER LINES TO PROVIDE 1'-6" VERTICAL AND 10'-0" HORIZONTAL CLEARANCE FROM SANITARY AND STORM SEWERS.

WML 23 IF THERE ARE ANY CONFLICTS IN GRADE BETWEEN WATER LINES AND GRAVITY SEWERS. THE WATER LINES SHALL BE LOWERED DURING CONSTRUCTION. CLEARANCES STATED MUST BE MAINTAINED.

WML 24 A PERMIT FOR EACH WATER SERVICE MUST BE OBTAINED FROM THE VILLAGE OF ASHVILLE, PRIOR TO MAKING A CONNECTION TO THE WATER SERVICE INSTALLED AS PART OF THIS PROJECT AND PRIOR TO MAKING ANY ADDITIONAL TAPS INTO THESE WATER LINES.

WML 25 THE WATER SERVICE TAPS SHALL CONSIST OF ALL PIPE, VALVES FITTINGS AND APPURTENANCES REQUIRED FROM AND INCLUDING THE WATER MAIN CONNECTION TO AND INCLUDING THE CONTROL VALVE AND BOX OR METER PIT.

WML 26 THE CAPS AND INSIDE OF ALL MAINLINE WATER VALVE BOXES SHALL BE PAINTED BLUE, AND THE CAPS AND INSIDE OF ALL FIRE HYDRANT GATE VALVE BOXES SHALL BE POINTED RED WITH TWO COATS OF RUST INHIBITIVE PAINT. PUBLIC FIRE HYDRANTS ARE TO BE PAINTED WITH TWO COATS OF FEDERAL SAFETY RED, SHERWIN WILLIAMS B54Y37 PER VILLAGE OF ASHVILLE 1507.08(A)(1). PRIVATE FIRE HYDRANTS ARE TO BE PAINTED FEDERAL SAFETY RED AND WHITE CAPS AND BONNETS PER VILLAGE OF ASHVILLE 1507.14(B)(4). HYDRANTS PLACES IN A FACTORY LOOPED SYSTEM SHALL BE PAINTED ALL FEDERAL SAFETY RED. WML 27 TAPPING SLEEVES ARE TO BE FORD METER BOX STYLE FTSS ALL STAINLESS STEEL OR JCM 432 ALL

WML 28 ALL GATE VALVES SHALL BE DUCTILE IRON RESILIENT WEDGE, TWO HUNDRED AND FIFTY (250) POUNDS PER SQUARE INCH (PSI), AS MANUFACTURED BY AMERICAN FLOW CONTROL OR APPROVED EQUIVALENT WHICH MEETS OR EXCEEDS THE REQUIREMENTS OF ANSI / AWWA C509.

WML 29 VALVE BOXES ARE TO BE TYLER 6500 SCREW TYPE FOR MAIN AND WATCH VALVES WITH FORD F-1000 CORPORATION STOPS, AND TYLER 94E CURB BOXES. VALVE BOXES ARE TO BE HEAVY DUTY IF LOCATED IN PAVED AREAS. CONTROL VALVES SHALL BE FORD Z44-333 VALVES.

WML 30 WATER MAIN CLEANING AND FLUSHING SHALL CONFORM TO ITEM 801.11 CMSC.

0" OUTSIDE OF THE RIGHT-OF-WAY LINE, WHENEVER PRACTICAL.

WML 31 HYDROSTATIC TESTS (AS REQUIRED IN SECTION 5 OF A.W.W.A C600) SHALL CONFORM TO ITEM 801.12 CMSC. 33. CHLORINATING OF COMPLETED PIPE LINE SHALL CONFORM TO ITEM 801.13 CMSC.

CORPORATION STOPS. CONTROL VALVES SHALL BE FORD Z44-333 VALVES. WML 33 WATER SERVICE BOXES ARE TO BE LOCATED IN PAIRS ALONG PROPERTY LINES. 8"-0" APART AND 2' -

WML 32 FOR WATER SERVICE TAPS, WATER MAIN CONNECTION SHALL BE MADE USING FORD F-1000

WML 34 ALL WATER LINES SHALL BE TESTED (AWWA 600) AND STERILIZED (AWWA C651) BY THE CONTRACTOR IN ACCORDANCE WITH THE VILLAGE OF ASHVILLE AND AWWA SPECIFICATIONS. TESTING SHALL BE DONE UNDER THE SUPERVISION OF THE VILLAGE ENGINEER OR HIS AUTHORIZED REPRESENTATIVE AT THE CONTRACTOR'S EXPENSE.

WML 35 IT IS THE POLICY OF THE VILLAGE OF ASHVILLE THAT THE DESIGN OF THE WATER DISTRIBUTION SYSTEM IMPROVEMENTS BE SUCH THAT THE WORKING PRESSURE SHOULD NOT BE LESS THAN THIRTY-FIVE (35) POUNDS PER SQUARE INCH (PSI) DURING PEAK FLOW CONDITIONS, OR MINIMUM OF TWENTY (20) PSI DURING PEAK FLOW PLUS FIRE FLOW CONDITIONS. INDIVIDUAL BOOSTER PUMPS FOR THE PURPOSE OF RAISING SUPPLY LINE PRESSURE SHALL NOT BE PERMITTED FOR NON-SINGLE FAMILY RESIDENTIAL APPLICATION.

WML 36 THE METER PIT FOR SINGLE-FAMILY RESIDENTIAL APPLICATION, INCLUDING ALL PIPING, FITTINGS, EQUIPMENT, AND APPURTENANCES ARE SUBJECT TO APPROVAL BY THE VILLAGE OF ASHVILLE PRIOR TO INSTALLATION. METER PITS UNABLE TO BE PROVIDED WITH A GRAVITY FLOOR DRAIN MUST BE INSTALLED IN A DEDICATED METER ROOM. GRAVITY DRAWS SHALL HAVE A BACKFLOW PREVENTION INSTALLED.

WML 37 THE PRESSURE REQUIRED TO PERFORM HYDROSTATIC TESTING ON WATER LINES MUST BE 150 PSI FOR DOMESTIC LINES AND 200 PSI FOR FIRE SUPPRESSION LINES (PER NFPA 13). HYDROSTATIC TESTS (AS REQUIRED IN SECTION 5 OF AWWA C 600) SHALL CONFORM TO ITEM 801.12 CMSC.

WML 38 CHLORINATION OF COMPLETED PIPELINE SHALL CONFORM TO ITEM 801.13 CMSC.GE OF ASHVILLE WATER DEPARTMENT FORTY-EIGHT.


H X  $\mathbf{D}$ B **IREE** TIO H NERA STR


≥回

REVISIONS


JOB NO. 1009 DRAWN BY DESIGN BY MJM CHECKED BY CMT

SHEET

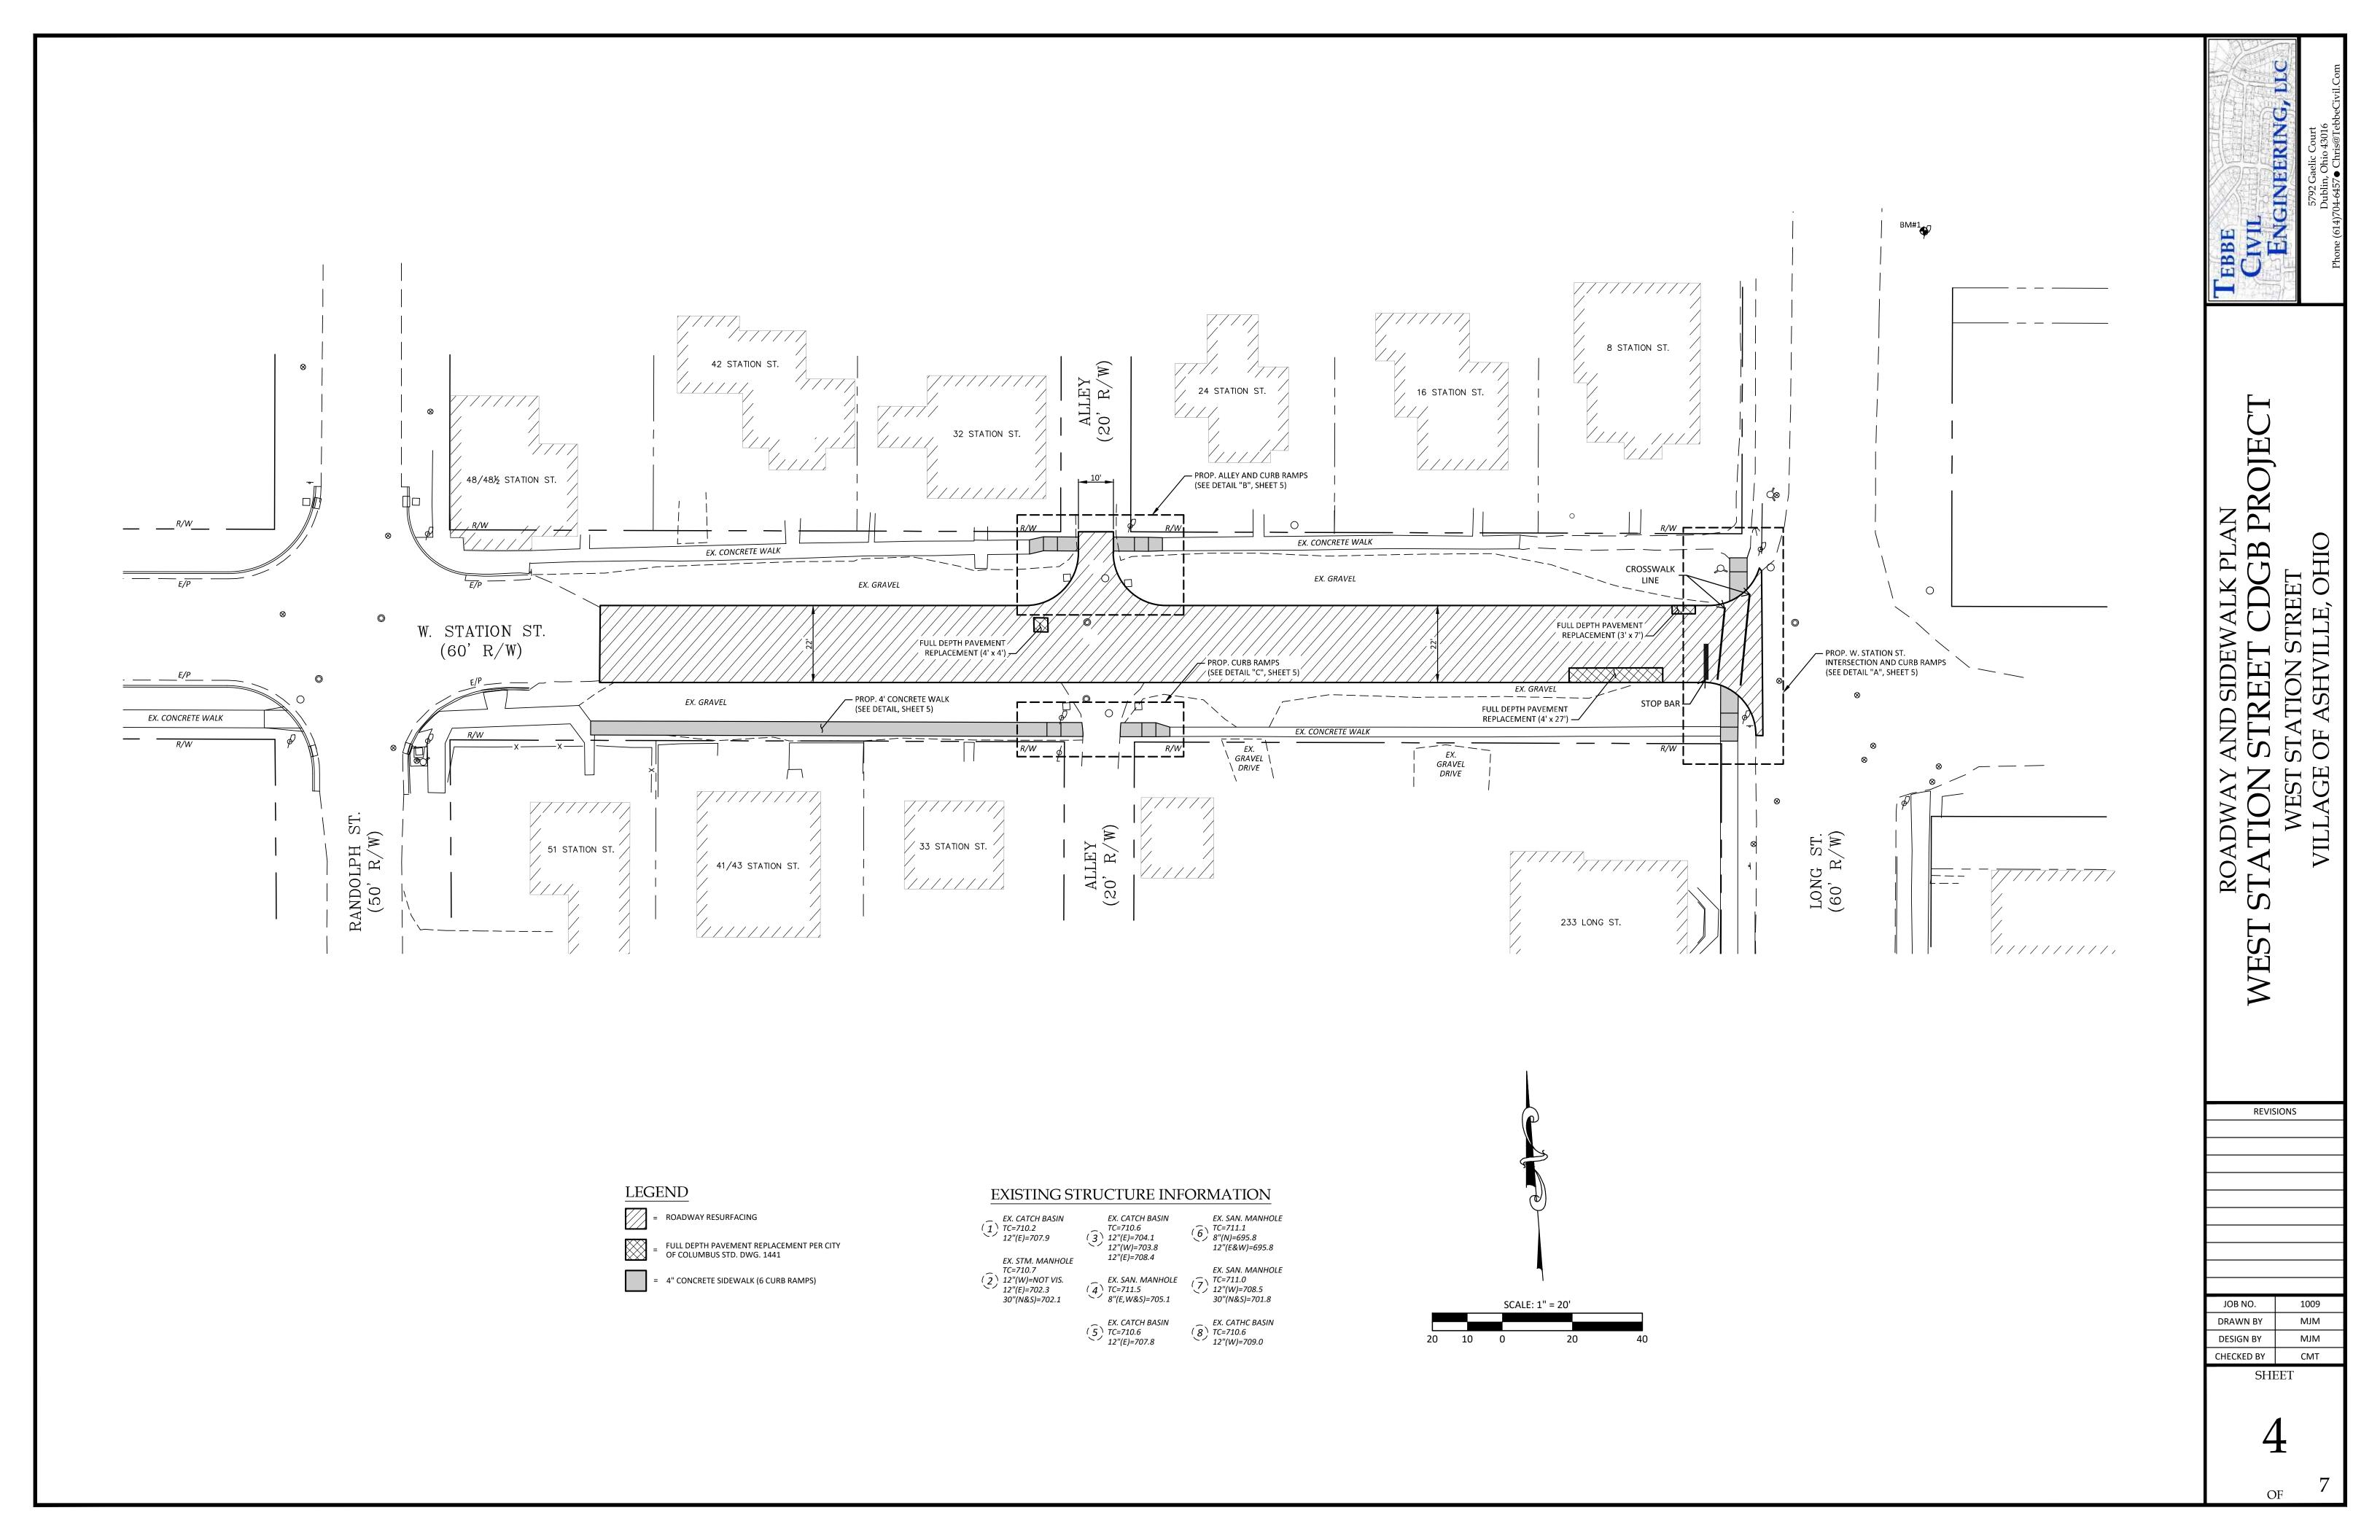


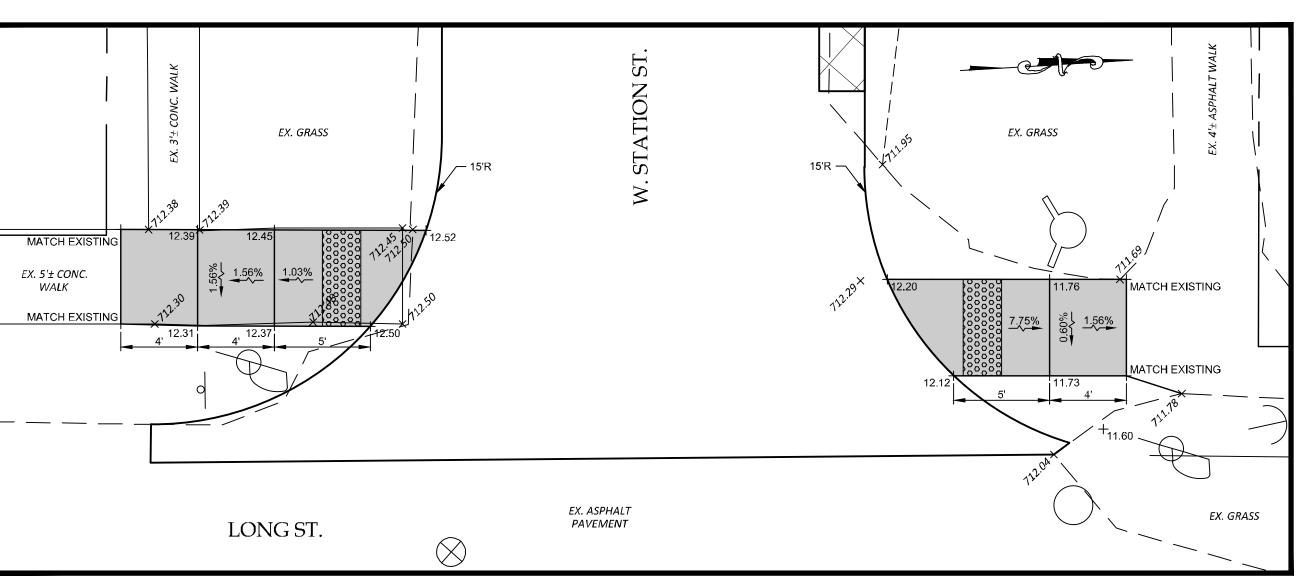


INTERSECTION & CURB RAMPS DETAIL "A" SCALE: 1" = 5"

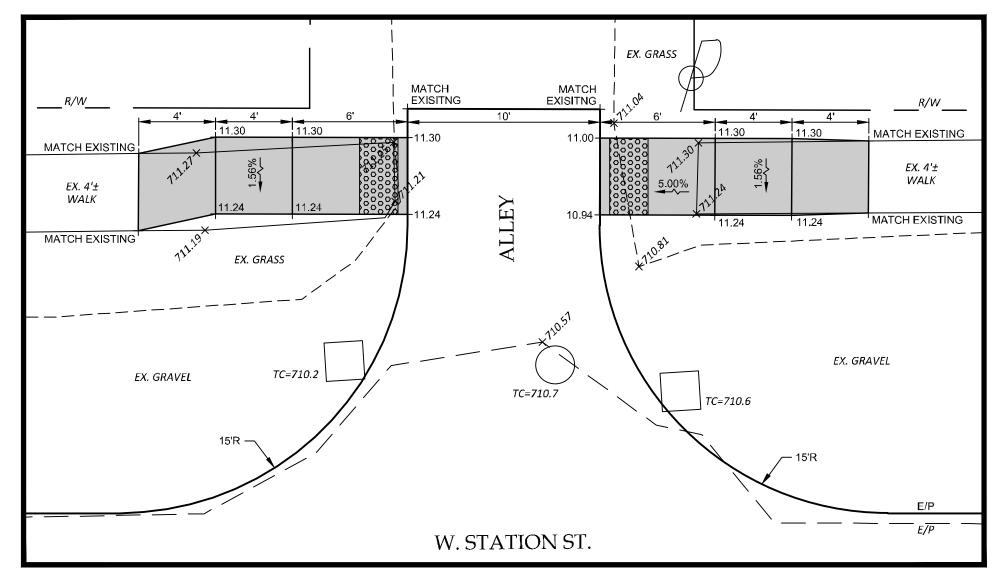

CURB RAMPS DETAIL "B" SCALE: 1" = 5"

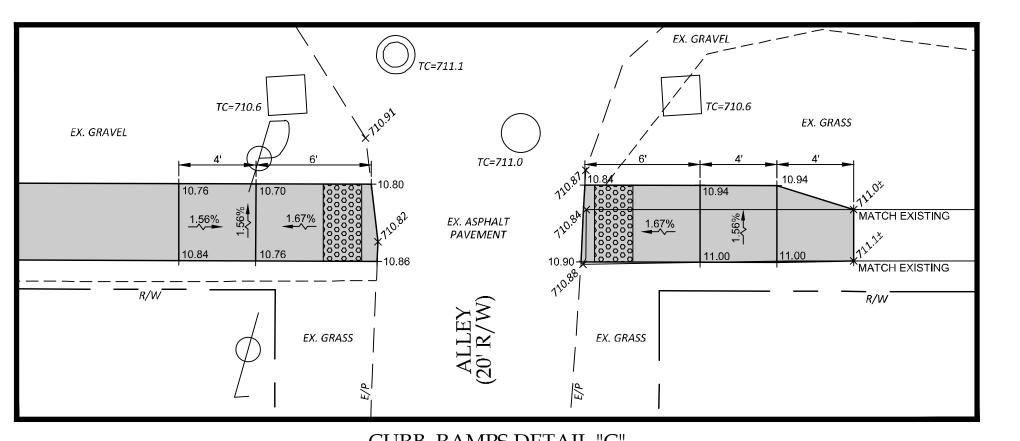


CURB RAMPS DETAIL "C" SCALE: 1" = 5"

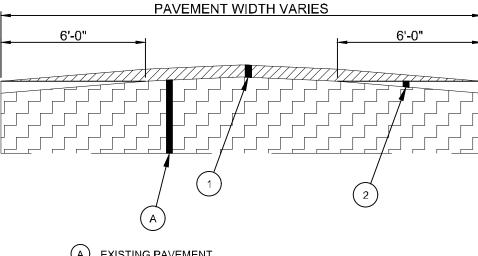

- (A) EXISTING PAVEMENT
- 1) PAVEMENT OVERLAY (SEE DETAIL BELOW)
- (2) ITEM 254, PAVEMENT PLANING, BITUMINOUS 1.5" DEPTH

1-1/2" OVERLAY DETAIL

SCALE: 1" = 1'

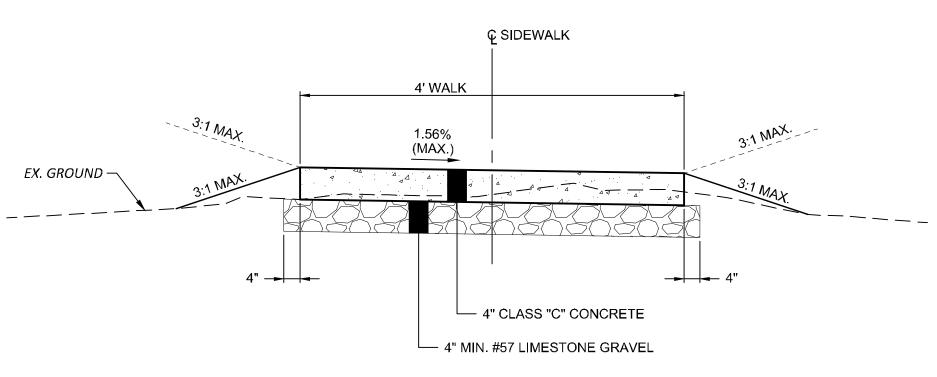

TYPICAL SIDEWALK SECTION SCALE: 1" = 1'

NOTE: THE BEDDING SHOULD CONSIST OF AN EVENLY GRADED, FREE FLOWING, GRANULAR MATERIAL WHICH IS FREE OF LARGE STONES OR FROZEN MATERIAL AND WITH PARTICLE SIZE OF UP TO APPROXIMATELY 10% OF THE PIPE SIZE AND NO LONGER THAN 11/2" IN SIZE.

PROJEC

REVISIONS

JOB NO. DRAWN BY **DESIGN BY** CHECKED BY CMT SHEET

OF

# STORM WATER POLLUTION PREVENTION PLAN NARRATIVE

PLAN DESIGNER: TEBBE CIVIL ENGINEERING, LLC 5792 GAELIC COURT

5792 GAELIC COURT
DUBLIN, OHIO 43016
PHONE: (614) 704-6457
EMAIL: Chris@TebbeCivil.com

OWNER/CONTACT: VILLAGE OF ASHVILLE

4 CHERRY STREET ASHVILLE, OHIO 43103 ATTN: DAVE BALLARD PHONE: (740) 983-6237

SITE CONTACT/CONTRACTOR: TO BE FILLED OUT PRIOR TO CONSTRUCTION

COMPANY:

CONTACT:

ADDRESS:

PHONE:

CONSTRUCTION START DATE:

DEVELOPMENT TYPE: ROADWAY AND SIDEWALK IMPROVEMENTS

PROJECT DESCRIPTION: PROJECT CONSISTS OF RESURFACING 332' OF STATION STREET,

INSTALLING 130' OF SIDEWALK AND ADDING 6 NEW CURB RAMPS

SITE DRAINS TO: SCIOTO RIVER

**CONSTRUCTION COMPLETION DATE:** 

**EXISTING CONDITION: EXISTING ROADWAY** 

# **SEDIMENT & EROSION CONTROL STANDARDS AND CRITERIA**

IN ORDER TO CONTROL SEDIMENT POLLUTION OF WATER RESOURCES THE OWNER OR PERSON RESPONSIBLE FOR THE DEVELOPMENT AREA SHALL USE CONSERVATION PLANNING AND PRACTICES TO MAINTAIN THE LEVEL OF CONSERVATION ESTABLISHED BY THE FOLLOWING STANDARDS:

- 1. TIMING OF SEDIMENT-TAPPING PRACTICES. SEDIMENT CONTROL PRACTICES SHALL BE FUNCTIONAL THROUGHOUT EARTH-DISTURBING PERIMETER CONTROLS, AND OTHER PRACTICES INTENDED TO TRAP SEDIMENT SHALL BE IMPLEMENTED AS THE FIRST STEP OF GRADING AND WITHIN SEVEN DAYS FROM THE START OF GRUBBING. THEY SHALL CONTINUE TO FUNCTION UNTIL THE UPSLOPE DEVELOPMENT AREA IS RESTABILIZED.
- 2. STABILIZATION OF DENUDED AREA. DENUDED AREAS SHALL HAVE SOIL STABILIZATION APPLIED WITHIN SEVEN DAYS IF THEY ARE TO REMAIN DORMANT FOR MORE THAN FORTY-FIVE DAYS. PERMANENT OR TEMPORARY SOIL STABILIZATION SHALL BE APPLIED TO DENUDED AREAS WITHIN SEVEN DAYS AFTER FINAL GRADE IS REACHED ON ANY PORTION OF THE SITE, AND SHALL ALSO BE APPLIED WITHIN SEVEN DAYS TO DENUDED AREAS WHICH MAY NOT BE AT FINAL GRADE, BUT WILL REMAIN DORMANT (UNDISTURBED) FOR LONGER THAN FORTY-FIVE DAYS.
- 3. SEDIMENT BARRIER. STREET FLOW RUNOFF FROM DENUDED AREAS SHALL BE FILTERED.
- 4. STORM SEWER INLET PROTECTION. ALL STORM SEWER INLETS WHICH ACCEPT WATER RUNOFF FROM THE DEVELOPMENT AREA SHALL BE PROTECTED SO THAT SEDIMENT-LADEN WATER WILL NOT ENTER THE STORM SEWER SYSTEM WITHOUT FIRST BEING FILTERED OR OTHER-WISE TREATED TO REMOVE SEDIMENT.
- 5. CONSTRUCTION ACCESS ROUTES. MEASURES SHALL BE TAKEN TO PREVENT SOIL TRANSPORT ONTO SURFACES WHERE RUNOFF IS NOT CHECKED BY SEDIMENT CONTROLS, OR ONTO PUBLIC ROADS.
- 6. CUT AND FILL SLOPES. CUT AND FILL SLOPES SHALL BE CONSTRUCTED IN A MANNER WHICH WILL MINIMIZE EROSION. CONSIDERATION SHALL BE GIVEN TO THE LENGTH AND STEEPNESS OF THE SLOPE, SOIL TYPE, UPSLOPE DRAINAGE AREA, GROUNDWATER CONDITIONS, AND SLOPE STABILIZATION.
- 7. ESTABLISHMENT OF PERMANENT VEGETATION. A PERMANENT VEGETATION SHALL NOT BE CONSIDERED ESTABLISHED UNTIL GROUND COVER IS ACHIEVED WHICH, IN THE OPINION OF THE APPROVING AGENCY, PROVIDES ADEQUATE COVER AND IS MATURE ENOUGH TO CONTROL SOIL EROSION SATISFACTORILY AND TO SURVIVE ADVERSE WEATHER CONDITIONS.
- 8. DISPOSITION OF TEMPORARY PRACTICES. ALL TEMPORARY EROSION AND SEDIMENT CONTROL PRACTICES SHALL BE DISPOSED OF WITHIN THIRTY DAYS AFTER FINAL SITE STABILIZATION IS ACHIEVED OR AFTER THE TEMPORARY PRACTICES ARE NO LONGER NEEDED, UNLESS OTHERWISE AUTHORIZED BY THE APPROVING AGENCY. TRAPPED SEDIMENT SHALL BE PERMANENTLY STABILIZED TO PREVENT FURTHER EROSION.
- 9. ALL TEMPORARY AND PERMANENT EROSION AND SEDIMENT CONTROL PRACTICES SHALL BE DESIGNED AND CONSTRUCTED TO MINIMIZE MAINTENANCE REQUIREMENTS. THEY SHALL BE MAINTAINED AND REPAIRED AS NEEDED TO ASSURE CONTINUED PERFORMANCE OF THEIR INTENDED FUNCTION.

# **NOTES**

THE USE OF STRAW WATTLES HAS PROVEN TO BE A VERSATILE AND EFFECTIVE EROSION AND SEDIMENT CONTROL BMP, ESPECIALLY IN RESIDENTIAL SETTINGS. STRAW WATTLES MAY BE SUBSTITUTED FOR SILT FENCE IN LINEAR INSTALLATIONS.

STREET CLEANING (ON AN AS-NEEDED BASIS) IS REQUIRED THROUGH THE DURATION OF THIS CONSTRUCTION PROJECT. THIS INCLUDES SWEEPING, POWER CLEANING AND (IF NECESSARY) MANUAL REMOVAL OF DIRT OR MUD IN THE STREET GUTTERS.

THE USE OF COMPOST FILTER SOCKS AND COMPOST BLANKETS ARE GAINING WIDER ACCEPTANCE NATIONWIDE. THEY ARE NOW APPROVED FOR USE ON ALL COLUMBUS SWP3 PLANS AND CONSTRUCTION SITES.

# SOIL EROSION NOTES CONSTRUCTION SEQUENCE

- 1. INSTALL PERIMETER SEDIMENT FENCE & STABILIZED CONSTRUCTION ENTRANCE.
- 2. GRADE AND STOCKPILE TOPSOIL
- A. SEDIMENT BARRIER AROUND STOCKPILE
- B. TEMPORARY SEEDING
- 3. VEGETATIVE COVER ALL AREAS TO BE EXPOSED LONGER THAN 45 DAYS
- VEGETATIVE COVER ALL (TEMPORARY SEEDING).
- 4. INSTALL UTILITIES


  A. INSTALL INLETS AND BASIN FILTERS AS SHOWN ON PLANS
- 5. INSTALL PAVEMENT SUBGRADE AND DITCHES INSTALL DITCH FILTERS AS SHOWN ON THE PLANS.
- 6. INSTALL IMPROVEMENTS AND FINAL GRADING.
- 7. PERFORM CONTINUING MAINTENANCE.
- 8. PERMANENT SEEDING AND MULCHING.
- 9. REMOVE SEDIMENT FILTER AFTER VEGETATION GROWTH IS ESTABLISHED.
- 10. ON SITE CONTACT: TO BE NAMED

EROSION CONTROL ESTIMATE OF QUANTITIES				
ITEM	QUANT	UNIT	DESCRIPTION	
207	5	EA	CATCH BASIN SEDIMENT FILTER	
207	140	LF	PERIMETER FILTER FABRIC FENCE	

TEMPORARY SEEDING & MULCHING FOR EROSION CONTROL				
SEED TYPE	SEEDING DATES	PER 1000 SQ FT	PER ACRE	
TALL FESCUE & ANNUAL RYEGRASS		2 POUNDS & 1/2 POUND	80 POUNDS & 20 POUNDS	
SMALL GRAIN STRAW	MARCH 1 TO SEPTEMBER 15	150 POUNDS OR 2 OR 3 BALES	3 TONS OR 75 BALES	
FERTILIZER		25 POUNDS OF 12-12-12 OR THE EQUIVALENT	1000 POUNDS OF 12-12-12 OR THE EQUIVALENT	
TEMPORARY SEEDING				
ANNUAL RYEGRASS OR WHEAT	SEPTEMBER 15 TO OCTOBER 30	3 POUNDS	2 BUSHELS	
SOIL PROTECTION				
SMALL GRAIN STRAW MULCH	OCTOBER 30 TO MARCH 1	2 TO 3 BALES	2 TONS	

SOIL PR	OTECTION CHART	ALL SEEDING ITEMS ARE COVERED UNDER ODOT SPECIFICATIONS.
STABILIZATIO TYPE		JUL AUG SEP OCT NOV DEC
PERMANENT SEEDING	+	<b></b>
DORMANT SEEDING	+	+
TEMPORARY SEEDING	+	<b></b>
SODDING	+	
MULCHING	+	

NOTE: THIS PLAN MUST BE POSTED ON-SITE. A COPY
OF THE SWPPP PLAN AND THE APPROVED EPA
STORMWATER PERMIT (WITH THE SITE-SPECIFIC NOI
NUMBER) SHALL BE KEPT ON-SITE AT ALL TIMES.

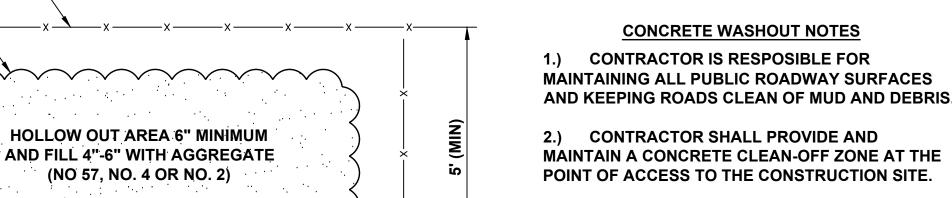

3.) THE CONTRACTOR SHALL DETERMINE A SUITABLE SITE FOR THE CONCRETE WASHOUT AREA THAT IS APPROVED BY THE ENGINEER.

4.) THE USE OF A PORTABLE CONCRETE WASHOUT IS ENCOURAGED.

# **CONCRETE WASHOUT AREA**

-NOT TO SCALE-

CONCRETE

WASHOUT

**AREA** 

SILT FENCE

8' (MIN)


10' (MIN)

SOIL BERM

**PLASTIC** 


**REQUIRED** 

**UNDERLINER** 

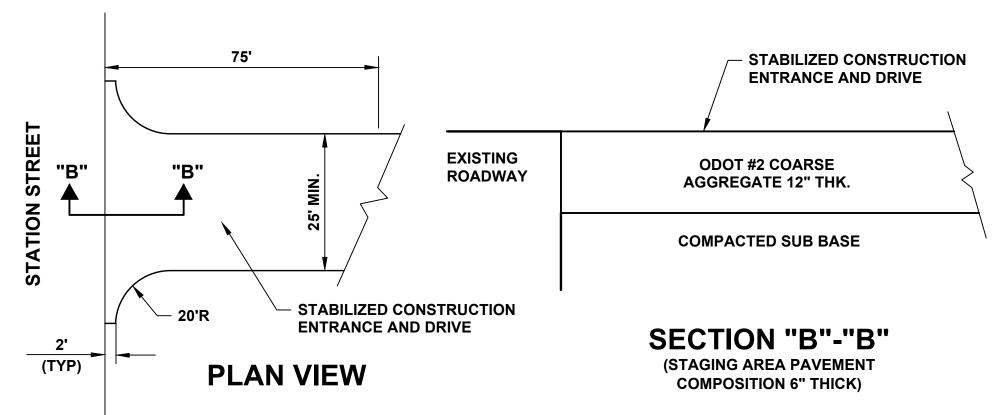

# STABILIZED CONSTRUCTION ENTRANCE DETAIL

THE EARTHWORK CONTRACTOR SHALL INSTALL AND MAINTAIN THE CONSTRUCTION ENTRANCE AND STAGING AREA.\* THE EARTHWORK CONTRACTOR SHALL PERIODICALLY ADD CLEAN STONE AND MAINTAIN THE GRAVEL EDGES FOR THE DURATION OF THE PROJECT. WHEN THE CONSTRUCTION ENTRANCE AND DRIVE ARE NO LONGER NEEDED, THE EARTHWORK CONTRACTOR SHALL REMOVE THE GRAVEL AND RESTORE THE GROUND TO ITS ORIGINAL CONDITION.

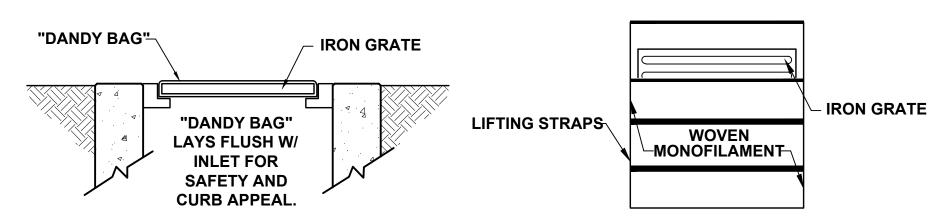

# **CATCH BASIN SEDIMENT FILTER**

MAINTENANCE: REMOVE DRIED SEDIMENT FROM SURFACE OF UNIT WITH A STIFF BRISTLE BROOM OR SQUARE POINT SHOVEL. REMOVE FINE MATERIAL FROM INSIDE ENVELOPE AS NEEDED. TO INSPECT CATCH BASIN: REMOVE UNIT WITH GRATE INSIDE, INSPECT CATCH BASIN AND REPLACE UNIT.

DANDY PRODUCTS INC., 2011 R HARRISBURG PIKE, GROVE CITY, OH 43123 (800) 591-2284 (614) 875-2284 FAX: (614) 875-6305.

# ACCEPTED ALTERNATES

FRYEFLOW SYSTEMS LINER IN STAND FRYEFLOW SYSTEMS P.O. BOX 622 GRANVILLE, OHIO 43023 PHONE: (740) 788-9150 FAX: (740) 788-9185 FLEX STORM INLET FILTERS ADVANCED DRAINAGE SYSTEMS, INC. 4640 TRUEMAN BOULEVARD HILLIARD, OHIO 43026 PHONE: (800) 821-6710 OR (614) 578-1561 FAX: (614) 658-0204

NOTE: SEE SHEET 7 FOR LOCATIONS WHERE USAGE OF CATCH BASIN SEDIMENT FILTER IS TO BE APPLIED.

FIGURERING

5792 Gaelic Court

Dublin, Ohio 43016

Phone (614)704-6457 • Chris@TebbeCivil.Com

WEST STATION STREET CDGB PROJEC
WEST STATION STREET
VILLAGE OF ASHVILLE, OHIO

REVISIONS

JOB NO. 1009

DRAWN BY MJM


DESIGN BY MJM

CHECKED BY CMT

SHEET

6

F

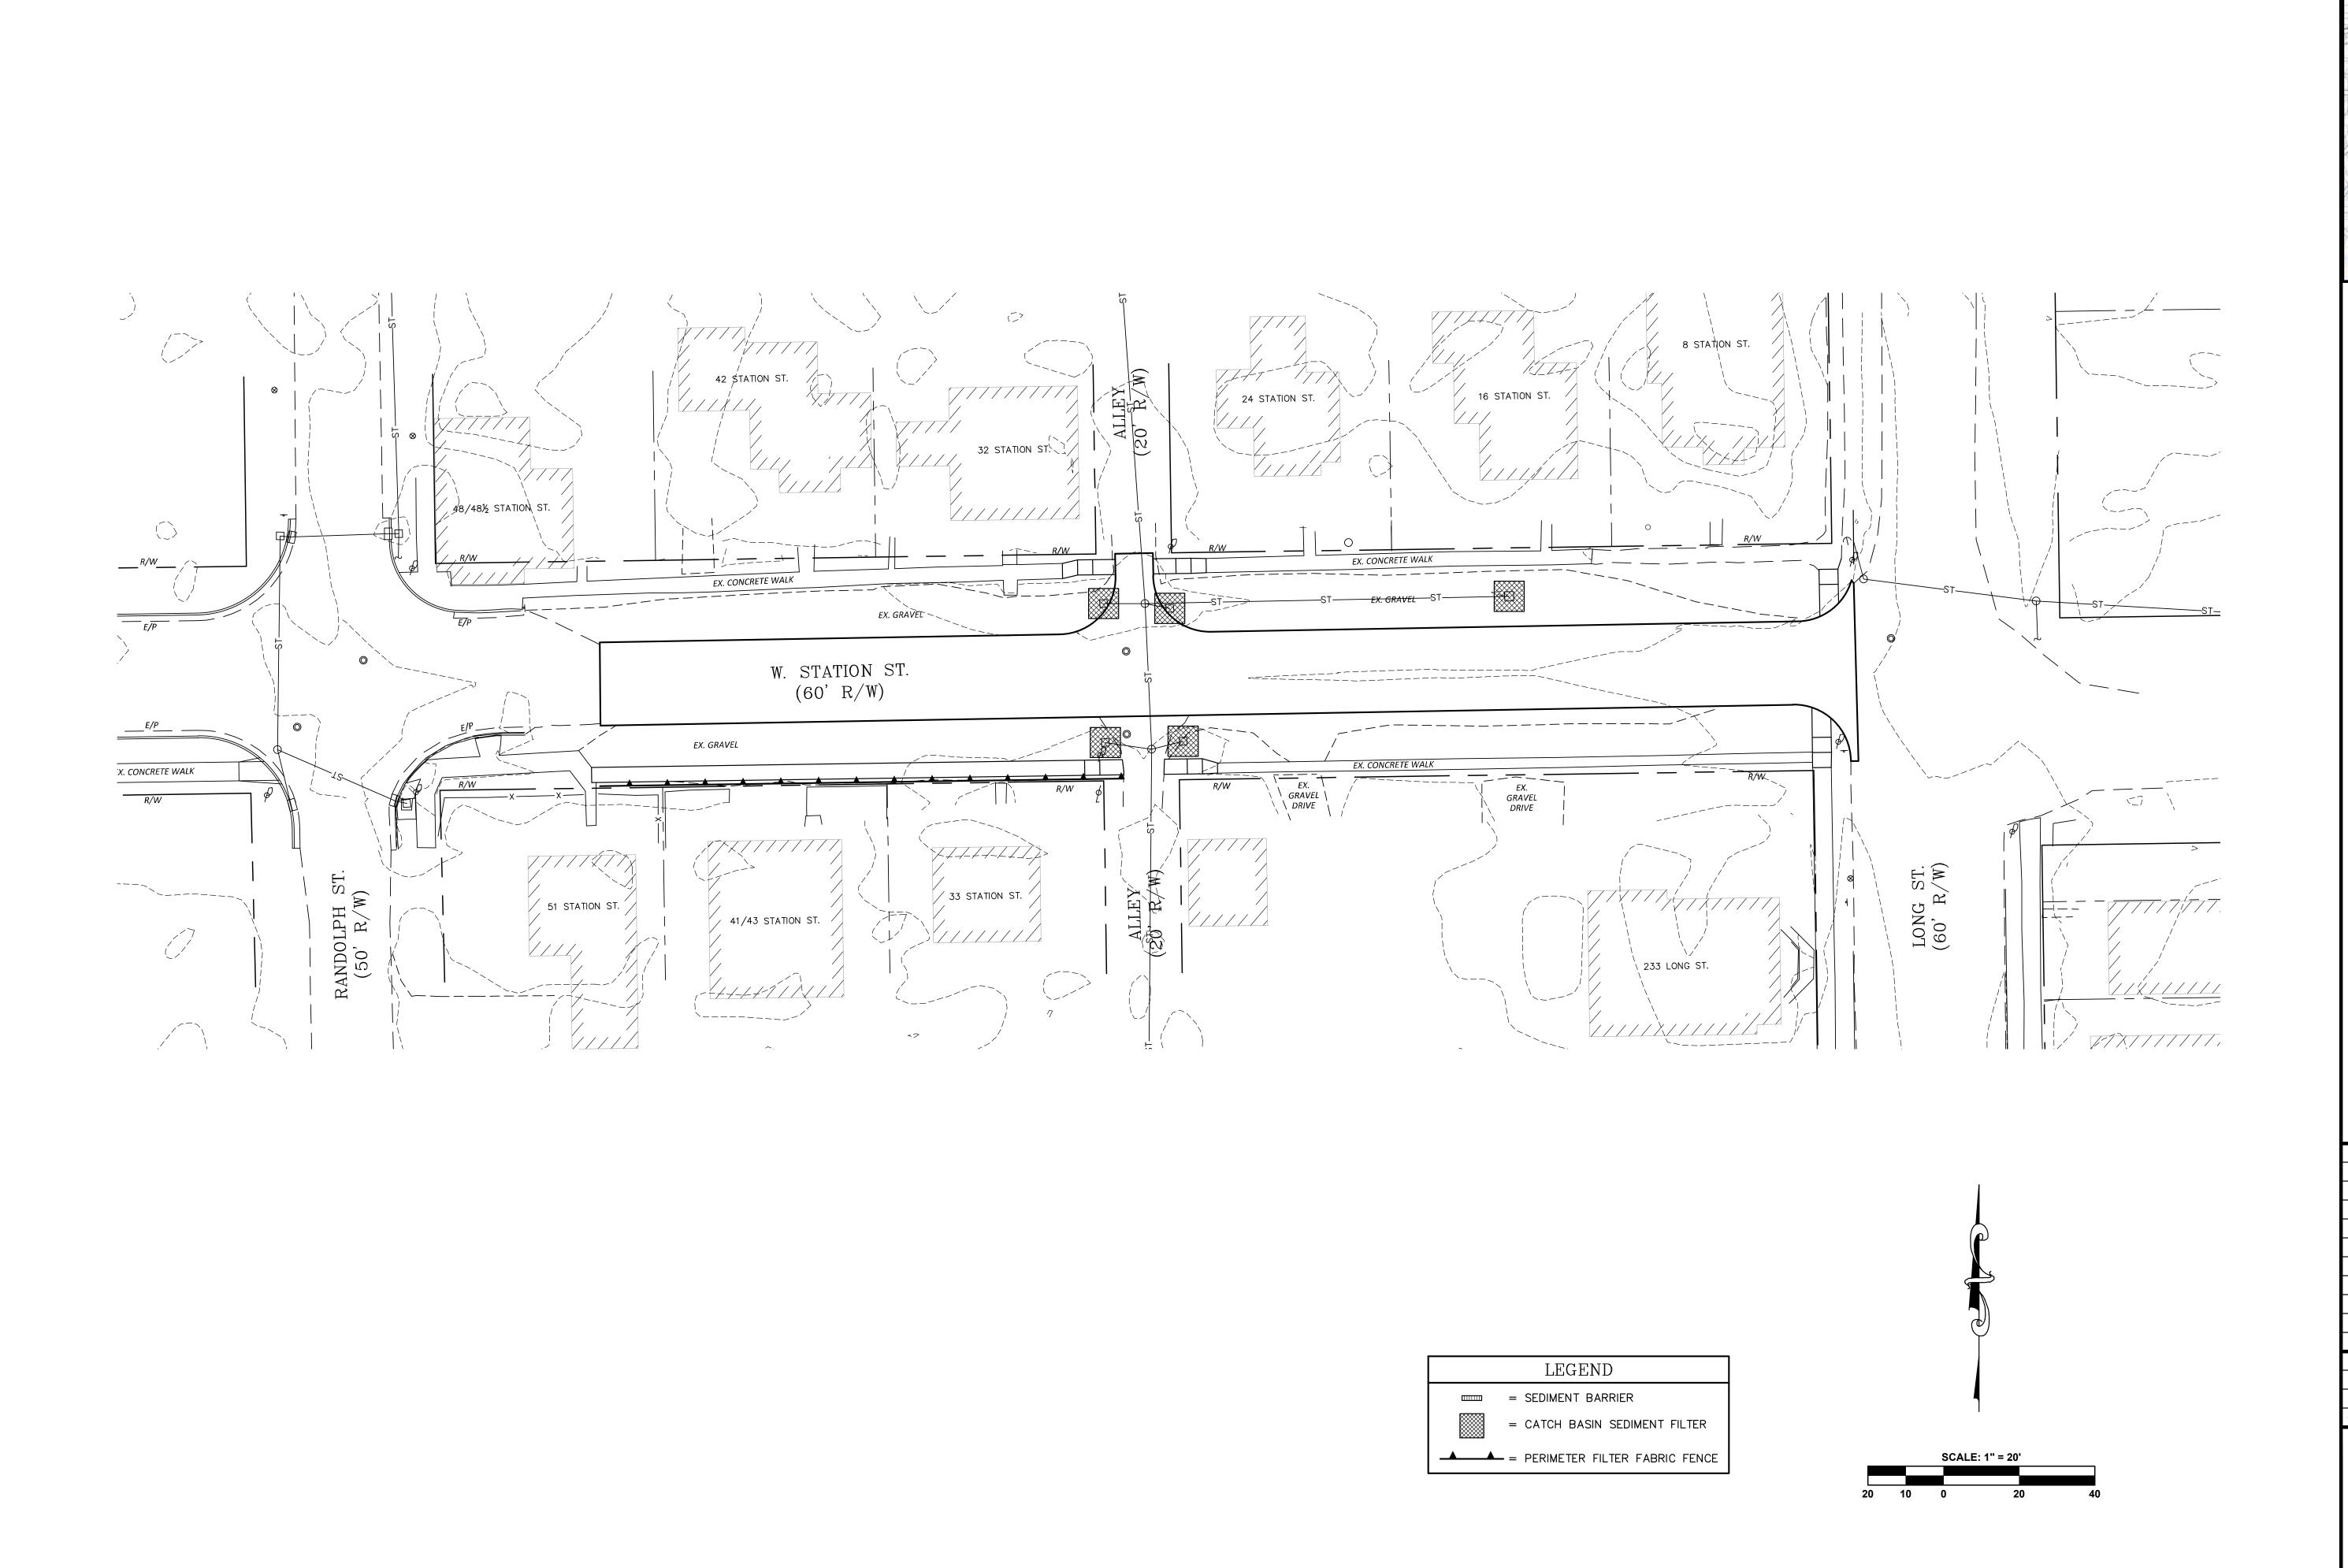

N CONTROL PLAN
STREET CDGB PROJECT 'EST STATION STREET AGE OF ASHVILLE, OHIO EROSION S'ATION S' WEST

REVISIONS

JOB NO.	1009		
DRAWN BY	MJM		
DESIGN BY	MJM		
CHECKED BY	СМТ		
SHEET			

OF